

NBSIR 75-705

**THERMAL AND FLOW CHARACTERISTICS OF
THE ASTM E 84 TUNNEL TEST METHOD**

James G. Quintiere and James W. Raines

Center for Fire Research
Institute for Applied Technology
National Bureau of Standards
Washington, D.C. 20234

September 1975

Final

U.S. DEPARTMENT OF COMMERCE, Rogers C.B. Morton, Secretary
James A. Baker, III, Under Secretary
Dr. Betsy Ancker-Johnson, Assistant Secretary for Science and Technology
NATIONAL BUREAU OF STANDARDS, Ernest Ambler, Acting Director



CONTENTS

	Page
LIST OF FIGURES	iv
LIST OF TABLES.	v
1. INTRODUCTION.	1
2. DESCRIPTION OF EXPERIMENTS.	2
3. RESULTS AND ANALYSIS.	3
3.1. Mass Flow Rate of Air	5
3.2. Energy Balance.	6
4. CONCLUSIONS	7
5. REFERENCES	8
APPENDIX A. TABULATION OF DATA	9
APPENDIX B. SI CONVERSION UNITS.	20

LIST OF FIGURES

	Page
Figure 1. Schematic of instrumentation. (1 in = 0.0254 m, 1 ft = 0.3048 m)	21
Figure 2. Flame tip position as a function of time. (1 ft = 0.3048 m)	22
Figure 3. Exit gas temperature as determined in the standard test for an energy release rating.	23
Figure 4a. Air mass flow rate of T374, nylon carpet. (1 lb/min = 0.00756 kg/s)	24
Figure 4b. Air mass flow rate for T375, wood carpet. (1 lb/min = 0.00756 kg/s)	25
Figure 4c. Air mass flow rate for T376, polypropylene carpet. (1 lb/min = 0.00756 kg/s)	26
Figure 4d. Air mass flow rate for T377, Nylon carpet (floor mounted). (1 lb/min = 0.00756 kg/s).	27
Figure 5. Enthalpy flow rate at section A for the calibration run. (1 Btu/min = 17.57 W) .	28
Figure 6. Enthalpy flow rate at section B for the calibration run. (1 Btu/min = 17.57 W) .	29
Figure 7a. Net energy loss rate between sections A and B for the calibration run. (1 Btu/min = 17.57 W)	30
Figure 7b. Net energy loss rate between sections A and B for T374, nylon carpet. (1 Btu/min = 17.57 W)	31
Figure 7c. Net energy loss rate between sections A and B for T375, wool carpet. (1 Btu/min = 17.57 W)	32
Figure 7d. Net energy loss rate between sections A and B for T376, polypropylene carpet. (1 Btu/min = 17.57 W)	33

LIST OF TABLES

	Page
Table 1. Description of Experiments	4
Table 2. Classification Results	5
Table A-1. Data Channel Code and Location	10
Table A-2. Experiment No. 1: Asbestos-Cement Board, Calibration Run.	11
Table A-3. Experiment No. 2: Polypropylene Carpet. . .	12
Table A-4. Experiment No. 3: Wool Carpet	14
Table A-5. Experiment No. 4: Nylon Carpet.	16
Table A-6. Experiment No. 5: Nylon Carpet (Floor Mount)	18

THERMAL AND FLOW CHARACTERISTICS
OF THE ASTM E 84 TUNNEL TEST METHOD

James G. Quintiere and James W. Raines

Five experiments were conducted using an ASTM E 84 tunnel test facility. These included a calibration test, three standard tests involving carpet materials, and one test in which a carpet material was tested on the floor of the duct. In addition to the measurements recorded during a standard test, instrumentation was added to measure inlet air velocity, temperature within the test section of the duct, and heat flux. From these measurements mass and energy balances were determined for each experiment. The results indicate that inlet air mass flow rate dropped during a test and appears to depend on the extent of burning in the duct. The energy balance results indicate that for the calibration run about half of the energy of the gas burner is lost by radiation and convection to the walls in the test section of the tunnel. During combustion of a test specimen, significant energy losses occur in the last 9 feet of the test section even after the flame tip has reached the exit of the tunnel.

Key words: ASTM E 84; carpets; energy balance; flame spread; mass balance; test method.

1. INTRODUCTION

Many building code and regulatory agencies set flammability acceptance requirements for interior surface lining material based on performance established by the ASTM E 84-70 [1]¹ tunnel test method. Essentially, the test consists of burning a material on the ceiling of a 25-foot duct under an initial air speed of 240 ft/min and an ignition exposure of 5,000 Btu/min. Classification of a material is expressed in terms of a comparative rating system for the categories of flame spread, fuel contribution, and smoke production. The method originated at Underwriters' Laboratories and was first described by Steiner in 1943 [2]. In 1950 it was approved by ASTM as a "Tentative Method."

¹Numbers in brackets correspond with the literature references listed at the end of this paper.

In recent years, a concern for carpet flammability has focused attention on the applicability of the "tunnel test" (ASTM E 84) in determining the flammability performance of floor coverings. In 1972, the National Building Code of Canada [3] adopted a modified version of ASTM E 84 for use in evaluating materials designed for floor application. Essentially, the modification consists of mounting the specimen on the floor of the tunnel and directing the ignition flame downward onto the material. Presumably, this change overcomes some problems associated with testing a flooring assembly mounted in a ceiling orientation. Another consideration, not restricted to flooring materials, concerns the variability of results from the tunnel test. Lee and Huggett [4] reported on an interlaboratory evaluation of the test method. They reported the variation in test performance within and among eleven laboratories. Other studies, by Endicott and Bowhay [5] and Groah [6], examined the effect on test performance of system variables.

In the present study, measurements of velocity and temperature were made during four tunnel tests. The sample materials were carpets. The purpose of the experiments was to assess the applicability of the tunnel test for measuring the flammability performance of floor covering materials. This subject has been discussed by Quintiere and Huggett [7], and it will not be pursued any further here. The present report deals with the results and analysis from these experiments which serve to characterize the thermal and flow conditions during a tunnel test.

2. DESCRIPTION OF EXPERIMENTS

The tunnel tests were conducted using the test facility [1] operated by the Hardwood Plywood Manufacturers Association in Arlington, Virginia. The instrumentation used in these experiments is shown in figure 1. An array of five pitot tubes was located in the plane of the rectangular orifice opening at the entrance of the tunnel. This arrangement would then provide a convenient means of determining total air inflow rate. Each pitot tube was connected to a pressure transducer which had been calibrated over a range of 0 to 0.1 inch of water. These calibrations showed a linear relationship between transducer voltage output and pressure difference. Arrays of thermocouples were positioned within the test section and at the end of the flame spread zone of the tunnel. At each station five thermocouples were arranged vertically 2 inches apart. Two thermocouples (Nos. 4 and 5) at section A-A (see fig. 1) attempted to measure the lateral variation in temperature; however, the support for these two thermocouples melted during the tests and these temperature data were disregarded. Bare chromel-alumel thermocouples were used.

A radiometer (with a sapphire window) was located 16 feet from the ignition burner and was positioned on the floor of the tunnel to view the burning specimen.

Five tests were run. Each test was conducted in the standard manner prescribed by ASTM E 84-70 [1] with one exception. The exception was the last test conducted, which mounted and directed the igniting burners downward to impinge a flame onto the floor. A description of the experiments and test materials is given in table 1. The same specimen materials were tested in experiments 4 and 5 to compare the standard ceiling-mounted results with a floor-mounted configuration.

All data were recorded on a digital data acquisition system over a time span for the standard test of 10 minutes duration. In experiment 1, velocity data were not recorded, and the radiometer was not used in experiment 5. A complete scan of all data channels was made each 10 seconds during the test and the resulting data were processed by computer.

3. RESULTS AND ANALYSIS

The flammability classification results are given in table 2. The classification results are based on measurements and observations recorded during a standard ASTM E 84 tunnel test. The prescription for determining the classification indices is described in reference [1]. The flame-spread classification is derived from observations of the flame tip as burning progresses along the sample. These results are plotted in figure 2. The "fuel factor" is based on the temperature-time curve of a thermocouple located at the exit end of the test chamber and 1 inch below the test specimen. These temperature curves are shown in figure 3. The smoke density factor given in table 2 is derived from the integral of light attenuation by the combustion products over the 10 minute duration of the test. All three of these classification indices can, in theory, be related to more quantitative flammability parameters such as rate or extent of flame spread, rate of energy release, and rate of smoke or particulate production. However, the interpretation and application of such quantitative parameters derived from the tunnel test remain to be specified.

The measurements taken beyond the standard test data are tabulated in appendix A. These data were analyzed to estimate the mass rate of air supply and the overall energy transfer rates in the tunnel.

Table 1. Description of Experiments

Expt. No.	HPMA No.*	Test Specimen	Comments
1	-	1/4 inch asbestos-cement board	Calibration test
2	T-376	Polypropylene carpet (level loop, 55 oz/yd ²)	Standard test
3	T-375	Wool carpet (woven level loop, 76 oz/yd ²) with a pad (hair-jute, 55 oz/yd ²)	Standard test
4	T-374	Nylon carpet (level loop, 89 oz/yd ²) with a pad (hair-jute, 55 oz/yd ²)	Standard test
5	T-377	Nylon carpet (level loop, 89 oz/yd ²) with a pad (hair-jute, 55 oz/yd ²)	Floor-mounted sample

* Hardwood Plywood Manufacturers Association test designation.
(Conversion to SI units: 1 inch = 0.0254 m, 1 oz/yd² = 0.0339 kg/m²).

Table 2. Classification Results

Test	Flame-spread Classification	Fuel Contributed Factor	Smoke Density Factor
Polypropylene carpet; T-376	69	20	110
Wool carpet; T-375	197	84	297
Nylon carpet; T-374	169	69	243
Nylon carpet, floor-mounted; T-377	107	78	565

3.1. Mass Flow Rate of Air

The velocity data taken at the slit was used, in part, to determine the mass flow rate of air supplied to the tunnel test section. The mass flow rate was calculated by using

$$\dot{m}_a = \rho V dA \quad (1)$$

which is approximated by

$$\dot{m}_a = \rho_a \sum_{i=1}^3 v_i A_i \quad (2)$$

The velocity is assumed to be uniform over each of three equal area segments, A_i ($3\frac{1}{8}" \times 6"$). Channel 16 was disregarded, and channels 14 and 18 were averaged for one area segment. The result of these approximations yields

$$\dot{m}_a = 0.130 \rho_a \left(v_{15} + \frac{v_{14} + v_{18}}{2} + v_{17} \right) \frac{\text{lb}_m}{\text{min}} \quad (3)$$

where $\rho_a = 0.0746 \text{ lb}_m/\text{ft}^3$

and v = velocity at the indicated channel location (ft/min).

The results for the four test runs are shown in figures 4a-d. It should be pointed out that the initial tunnel flow rate, corresponding to test section conditions of 240 ft/min and 21°C, is 25.4 lb/min. Note that in each test the air velocity decreased over most or all of the tests and that this decrease ranged from about 19 to more than 28%.

3.2. Energy Balance

By using the temperature profile data at the 15 and 24 foot stations in the test section along with the measured air supply rate, several energy balances can be made to estimate the magnitude of the energy flows in the tunnel. An energy balance applied to a control volume encompassing the test section space, bounded by the walls of the duct and stations 1 and 2, where station 2 is downstream of 1, is given approximately as

$$\dot{m}_a C_p (T_2 - T_1) = \dot{E} - \dot{Q}_l \quad (4)$$

where $T_{1,2}$ is an effective temperature,

\dot{E} is the energy release rate due to combustion, and

\dot{Q}_l is the conductive wall heat loss rate and radiative loss rate.

The mass of gas from the burners and the pyrolysis mass flow from the burning sample are small compared to the air supply and were neglected in the energy balance. The gas burner fuel contribution is about 5,000 Btu/min based on a design specification of the test method. Actually, for these experiments the gas flow rate to the burner indicated an average of 4,750 Btu/min based on a lower heating (net) value and 5,280 Btu/min based on a higher heating (gross) value. The 5,000 value was used in the subsequent calculations, although it is probably more correct to use 4,750 Btu/min. An average value of c_p was taken to be 0.202 Btu/lb°R which corresponds to nitrogen at 427°C. An effective temperature was determined by an area-weighted average. For example, at station B

$$T_B = \frac{T_{10} + T_{11} + T_{12}}{6} + \frac{T_9 + T_{13}}{4} \quad (5)$$

This would correspond to a bulk temperature, provided the mass velocity (ρV) is equal over the duct cross section. It would

overestimate the bulk temperature if velocity (V) were equal over the cross section. The results of several energy balances will be given.

Figures 5 and 6 show the convective enthalpy flow rates at stations A and B, respectively, for the calibration test. In both cases (A and B) the energy loss rate is given by

$$\dot{Q}_i = 5,000 \frac{\text{Btu}}{\text{min}} - \dot{m}_a c_p (T_i - T_\infty), \quad i = A, B \quad (6)$$

where a constant $\dot{m}_a = 25.4 \text{ lb/min}$ was used. It is seen that for a 5,000 Btu/min burner energy release rate, more than 2,000 Btu/min is lost before station A, and an additional 600 Btu/min loss is incurred between stations A and B.

Figures 7a through 7d display the net energy loss rate for a control volume bounded by sections A and B. The net energy loss rate is the difference $\dot{Q}_\ell - \dot{E}$ and was determined by

$$\dot{Q}_\ell - \dot{E} = \dot{m}_a c_p (T_A - T_B) \quad (7)$$

In Figure 7a, the calibration run, no energy release takes place between A and B; hence, only the loss associated with the burner is displayed. In figures 7b and 7c it is interesting to notice that a net energy production rate is not established between A and B until well after the specimen flame has reached the end of the duct.

4. CONCLUSIONS

Velocity measurements and calculations have shown a drop in air supply rate during burn in the ASTM E 84 tunnel test. The drop in air flow was at least 19 percent in all of the cases tested. It is not known if this drop in flow is associated with a temperature rise in the duct [7], mass transfer by the specimen, or whether it is peculiar to a particular tunnel facility. Moreover, it is not known what effect this reduction in oxygen supply has on tunnel flame spread and smoke measurements.

The energy balance calculations give some insight to the magnitude of energy flows in the tunnel. There appears to be a substantial loss of energy near the burner flame. Also, the energy losses appear to be significant during burning, at least during the time period in which the flame has not yet reached the end of the duct.

5. REFERENCES

- [1] Standard Test Method for Surface Burning Characteristics of Building Materials, ASTM E 84-70, American Society of Testing and Materials, Philadelphia, Pennsylvania, 1970.
- [2] Steiner, A. J., Method of Fire-Hazard Classification of Building Materials, ASTM Bulletin, 19-22 (Mar. 1943).
- [3] Standard Method of Test for Surface Burning Characteristics of Flooring and Floor Covering Materials, CSA B 54.9-1972, Canadian Standards Association (1972).
- [4] Lee, T. G. and Huggett, C., Interlaboratory Evaluation of the Tunnel Test (ASTM E 84) Applied to Floor Coverings, Nat. Bur. Stand. (U.S.), NBSIR 73-125 (Mar. 1973).
- [5] Endicott, L. E. and Bowhay, R. B., A Statistical Evaluation of the Fire Hazard Classification Furnace (ASTM E 84-68), Materials Research and Standards, American Society of Testing and Materials, Philadelphia, Pennsylvania, 19-21, 50, 52 (May 1970).
- [6] Groah, W. J., A Study of Certain Operating and Material Variables of the 25-Foot Tunnel Flamespread Test, Forest products Journal, Vol. 23, No. 12, 39-45 (Dec. 1973).
- [7] Quintiere, J. and Huggett, C., An Evaluation of Flame Spread Test Methods for Floor Covering Materials, Fire Safety Research, Proceedings of a Symposium on Fire held at the National Bureau of Standards on August 22, 1973, Nat. Bur. Stand. (U.S.), Special Publication SP-411 (Nov. 1974).

APPENDIX A. TABULATION OF DATA

The temperature, velocity, and heat flux data are tabulated for each experiment. Table A-1 lists the data channel numbers and corresponding sensors as indicated in figure 1. Tables A-2 through A-6 list the data taken for each experiment. In some cases data were faulty or changes were made in sensor location. In all the experiments channel 16 yielded erroneous velocity data due to an improper installation. Channel 14 in experiment 2 appeared, initially, to give an erroneously high output. In experiments 1 through 4, the thermocouples on channels 4 and 5 may not have remained in position and these data should be regarded with caution. In experiment 5, thermocouples 4 and 5 were relocated to measure temperature near the ceiling and at the carpet surface, respectively. Also, in experiment 5 some thermocouples apparently did not function properly, and the heat fluxmeter was not used. Finally, it should be noted that velocity and heat flux measurements were not taken in experiment 1.

Table A-1. Data Channel Code and Location

Channel No.	Measurement	Units *	Location
2	Temperature	°C	Centerline of Section A, 10 inches above floor
3	Temperature	°C	Centerline of Section A, 8 inches above floor
4	Temperature	°C	4.5 inches left of centerline at Section A, 8 inches above floor ¹
5	Temperature	°C	4.5 inches right of centerline at Section A, 8 inches above floor ²
6	Temperature	°C	Centerline of Section A, 6 inches above floor
7	Temperature	°C	Centerline of Section A, 4 inches above floor
8	Temperature	°C	Centerline of Section A, 2 inches above floor
9	Temperature	°C	Centerline of Section B, 10 inches above floor
10	Temperature	°C	Centerline of Section B, 8 inches above floor
11	Temperature	°C	Centerline of Section B, 6 inches above floor
12	Temperature	°C	Centerline of Section B, 4 inches above floor
13	Temperature	°C	Centerline of Section B, 2 inches above floor
14	Velocity	ft/min	Centerline of Section C, 2.5 inches above floor ³
15	Velocity	ft/min	6 inches left of centerline at Section C, 1.5 inch above floor ³
16	Velocity	ft/min	Centerline of Section C, 1.5 inch above floor ³
17	Velocity	ft/min	6 inches right of centerline at Section C, 1.5 inch above floor ³
18	Velocity	ft/min	Centerline of Section C, .5 inch above floor ³
19	Radiant heat flux	Btu/ft ² s	Centerline of floor, 16 ft from burner ⁴

¹Location changed to ceiling in Expt. 5²Location changed to floor in Expt. 5³Velocity data not recorded in Expt. 1.⁴Heat flux data not recorded in Expt. 1 and 5.* These units correspond to data in Tables A2 thru A6
Conversions to SI units: 1 inch = 0.0254 m, 1 ft/min = $\frac{0.00508}{60}$ m/s, 1 Btu/ft²s = 1.135 W/cm².

E-84 TUNNEL TEST CALIBRATION RUN (CEMENT ASBESTOS BOARD)

Table A-2. Experiment No. 1: Asbestos-Cement Board, Calibration Run

CHANNEL IDENT.	1	2	3	4	5	6	7	8	9	10	11	12	13
SECONDS	-10.00	-10.00	41.00	51.00	57.00	54.00	50.00	39.00	37.00	41.00	32.00	29.00	29.00
	*0.0	*0.0	34.00	44.00	57.00	57.00	50.00	29.00	27.00	29.00	27.00	24.00	22.00
	10.00	10.00	51.00	51.00	57.00	57.00	41.00	51.00	49.00	49.00	46.00	46.00	39.00
	20.00	20.00	29.00	16.00	41.00	39.00	46.00	54.00	66.00	180.00	145.00	145.00	61.00
	30.00	30.00	37.00	37.00	13.00	13.00	13.00	13.00	13.00	13.00	13.00	13.00	13.00
	40.00	40.00	30.00	260.00	260.00	260.00	260.00	260.00	260.00	260.00	260.00	260.00	260.00
	50.00	50.00	325.00	255.00	255.00	255.00	200.00	203.00	190.00	190.00	195.00	195.00	195.00
	60.00	60.00	326.00	248.00	248.00	248.00	199.00	195.00	152.00	152.00	197.00	197.00	117.00
	70.00	70.00	363.00	265.00	213.00	206.00	190.00	147.00	147.00	147.00	145.00	145.00	120.00
	80.00	80.00	315.00	243.00	195.00	201.00	190.00	130.00	120.00	250.00	199.00	199.00	122.00
	90.00	90.00	351.00	275.00	201.00	190.00	190.00	105.00	105.00	235.00	197.00	197.00	127.00
	100.00	100.00	170.00	351.00	252.00	211.00	197.00	206.00	206.00	250.00	197.00	197.00	112.00
	110.00	110.00	170.00	342.00	255.00	211.00	201.00	155.00	120.00	120.00	165.00	165.00	112.00
	120.00	120.00	337.00	272.00	273.00	233.00	211.00	160.00	115.00	257.00	120.00	120.00	112.00
	130.00	130.00	341.00	262.00	270.00	221.00	203.00	167.00	120.00	252.00	170.00	170.00	112.00
	140.00	140.00	180.00	351.00	228.00	206.00	206.00	165.00	120.00	250.00	170.00	170.00	112.00
	150.00	150.00	180.00	326.00	245.00	208.00	216.00	216.00	216.00	216.00	216.00	216.00	112.00
	160.00	160.00	170.00	337.00	260.00	216.00	201.00	150.00	120.00	120.00	206.00	206.00	112.00
	170.00	170.00	345.00	275.00	273.00	215.00	201.00	147.00	120.00	120.00	205.00	205.00	112.00
	180.00	180.00	160.00	343.00	260.00	200.00	218.00	212.00	160.00	115.00	204.00	204.00	112.00
	190.00	190.00	343.00	270.00	270.00	220.00	208.00	208.00	170.00	125.00	213.00	213.00	112.00
	200.00	200.00	210.00	356.00	275.00	233.00	238.00	238.00	125.00	125.00	212.00	212.00	112.00
	210.00	210.00	210.00	451.00	250.00	242.00	218.00	216.00	130.00	130.00	225.00	225.00	112.00
	220.00	220.00	220.00	351.00	252.00	211.00	223.00	206.00	160.00	122.00	250.00	250.00	112.00
	230.00	230.00	230.00	356.00	267.00	223.00	223.00	216.00	160.00	125.00	250.00	250.00	112.00
	240.00	240.00	240.00	337.00	270.00	273.00	273.00	216.00	157.00	157.00	208.00	208.00	112.00
	250.00	250.00	250.00	365.00	270.00	270.00	218.00	212.00	120.00	125.00	250.00	250.00	112.00
	260.00	260.00	260.00	365.00	277.00	245.00	245.00	223.00	125.00	125.00	213.00	213.00	112.00
	270.00	270.00	270.00	367.00	270.00	233.00	218.00	221.00	140.00	140.00	147.00	147.00	112.00
	280.00	280.00	280.00	351.00	267.00	270.00	230.00	218.00	162.00	137.00	267.00	267.00	112.00
	290.00	290.00	290.00	360.00	270.00	221.00	221.00	206.00	160.00	122.00	250.00	250.00	112.00
	300.00	300.00	300.00	350.00	270.00	223.00	230.00	223.00	120.00	125.00	265.00	265.00	112.00
	310.00	310.00	310.00	348.00	292.00	235.00	221.00	221.00	140.00	140.00	272.00	272.00	112.00
	320.00	320.00	320.00	368.00	292.00	249.00	249.00	243.00	190.00	190.00	267.00	267.00	112.00
	330.00	330.00	330.00	367.00	287.00	270.00	287.00	270.00	162.00	162.00	270.00	270.00	112.00
	340.00	340.00	340.00	370.00	270.00	270.00	230.00	230.00	177.00	177.00	272.00	272.00	112.00
	350.00	350.00	350.00	350.00	290.00	290.00	216.00	216.00	165.00	127.00	260.00	260.00	112.00
	360.00	360.00	360.00	355.00	291.00	240.00	230.00	243.00	177.00	140.00	262.00	262.00	112.00
	370.00	370.00	370.00	377.00	292.00	235.00	223.00	223.00	177.00	152.00	272.00	272.00	112.00
	380.00	380.00	380.00	366.00	289.00	249.00	249.00	243.00	190.00	140.00	270.00	270.00	112.00
	390.00	390.00	390.00	365.00	287.00	246.00	246.00	245.00	195.00	152.00	270.00	270.00	112.00
	400.00	400.00	400.00	370.00	292.00	243.00	250.00	243.00	170.00	147.00	272.00	272.00	112.00
	410.00	410.00	410.00	360.00	360.00	245.00	245.00	245.00	175.00	150.00	270.00	270.00	112.00
	420.00	420.00	420.00	356.00	294.00	245.00	245.00	245.00	190.00	150.00	272.00	272.00	112.00
	430.00	430.00	430.00	353.00	296.00	245.00	245.00	238.00	192.00	167.00	272.00	272.00	112.00
	440.00	440.00	440.00	366.00	296.00	245.00	245.00	245.00	197.00	155.00	275.00	275.00	112.00
	450.00	450.00	450.00	355.00	296.00	245.00	245.00	248.00	190.00	152.00	270.00	270.00	112.00
	460.00	460.00	460.00	370.00	360.00	245.00	245.00	245.00	170.00	147.00	270.00	270.00	112.00
	470.00	470.00	470.00	370.00	360.00	245.00	245.00	245.00	170.00	147.00	270.00	270.00	112.00
	480.00	480.00	480.00	351.00	295.00	245.00	245.00	245.00	190.00	150.00	272.00	272.00	112.00
	490.00	490.00	490.00	353.00	295.00	245.00	245.00	238.00	187.00	150.00	272.00	272.00	112.00
	500.00	500.00	500.00	365.00	295.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	510.00	510.00	510.00	366.00	296.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	520.00	520.00	520.00	370.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	530.00	530.00	530.00	355.00	355.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	540.00	540.00	540.00	377.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	550.00	550.00	550.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	560.00	560.00	560.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	570.00	570.00	570.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	580.00	580.00	580.00	367.00	367.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	590.00	590.00	590.00	375.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	600.00	600.00	600.00	390.00	390.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	610.00	610.00	610.00	377.00	377.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	620.00	620.00	620.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	630.00	630.00	630.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	640.00	640.00	640.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	650.00	650.00	650.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	660.00	660.00	660.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	670.00	670.00	670.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	680.00	680.00	680.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	690.00	690.00	690.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	700.00	700.00	700.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00	275.00	275.00	112.00
	710.00	710.00	710.00	365.00	365.00	245.00	245.00	245.00	195.00	155.00			

Table A-3. Experiment No. 2: Polypropylene Carpet

SECONDS	CHANNEL IDENT.											
	1	2	3	4	5	6	7	8	9	10	11	12
-10.00	-10.00	32.00	37.00	37.00	32.00	32.00	29.00	29.00	29.00	29.00	29.00	29.00
.00	.00	39.00	37.00	34.00	37.00	51.00	37.00	41.00	37.00	37.00	37.00	37.00
10.00	10.00	24.00	37.00	29.00	29.00	29.00	24.00	24.00	24.00	24.00	24.00	24.00
20.00	20.00	221.00	172.00	170.00	157.00	157.00	68.00	63.00	218.00	170.00	120.00	27.00
30.00	30.00	344.00	252.00	270.00	187.00	187.00	107.00	98.00	243.00	195.00	145.00	85.00
40.00	40.00	353.00	262.00	218.00	201.00	195.00	140.00	107.00	262.00	203.00	167.00	112.00
50.00	50.00	50.00	360.00	284.00	199.00	211.00	142.00	102.00	267.00	208.00	165.00	125.00
60.00	60.00	368.00	272.00	201.00	203.00	211.00	145.00	122.00	270.00	214.00	177.00	127.00
70.00	70.00	375.00	279.00	228.00	228.00	182.00	157.00	132.00	277.00	228.00	180.00	140.00
80.00	80.00	375.00	313.00	250.00	252.00	238.00	167.00	142.00	279.00	230.00	197.00	132.00
90.00	90.00	388.00	320.00	270.00	275.00	208.00	182.00	162.00	280.00	211.00	182.00	150.00
100.00	100.00	110.00	456.00	358.00	361.00	291.00	228.00	206.00	298.00	267.00	225.00	192.00
110.00	110.00	110.00	514.00	398.00	319.00	315.00	262.00	206.00	315.00	284.00	252.00	216.00
120.00	120.00	516.00	516.00	473.00	377.00	358.00	310.00	260.00	334.00	294.00	262.00	233.00
130.00	130.00	568.00	498.00	409.00	379.00	358.00	287.00	260.00	329.00	301.00	265.00	225.00
140.00	140.00	552.00	505.00	377.00	360.00	286.00	270.00	270.00	334.00	310.00	272.00	240.00
150.00	150.00	561.00	528.00	385.00	405.00	386.00	315.00	292.00	346.00	317.00	277.00	245.00
160.00	160.00	568.00	567.00	407.00	407.00	391.00	286.00	365.00	329.00	301.00	294.00	265.00
170.00	170.00	547.00	495.00	400.00	389.00	370.00	313.00	292.00	353.00	327.00	287.00	257.00
180.00	180.00	528.00	454.00	379.00	382.00	368.00	313.00	286.00	317.00	292.00	265.00	233.00
190.00	190.00	549.00	456.00	389.00	356.00	365.00	303.00	277.00	353.00	313.00	286.00	265.00
200.00	200.00	547.00	440.00	356.00	370.00	375.00	317.00	289.00	348.00	308.00	277.00	255.00
210.00	210.00	505.00	379.00	317.00	356.00	365.00	298.00	279.00	327.00	294.00	267.00	243.00
220.00	220.00	507.00	402.00	332.00	348.00	346.00	275.00	275.00	331.00	301.00	277.00	252.00
230.00	230.00	492.00	353.00	353.00	320.00	322.00	267.00	267.00	327.00	286.00	270.00	243.00
240.00	240.00	461.00	461.00	325.00	325.00	325.00	322.00	272.00	262.00	262.00	265.00	265.00
250.00	250.00	461.00	449.00	313.00	346.00	346.00	304.00	322.00	292.00	292.00	289.00	265.00
260.00	260.00	438.00	360.00	105.00	341.00	325.00	375.00	275.00	327.00	313.00	270.00	233.00
270.00	270.00	402.00	341.00	341.00	305.00	306.00	265.00	293.00	293.00	291.00	277.00	243.00
280.00	280.00	412.00	353.00	353.00	320.00	320.00	294.00	267.00	320.00	301.00	277.00	221.00
290.00	290.00	407.00	337.00	337.00	292.00	292.00	292.00	267.00	223.00	223.00	248.00	223.00
300.00	300.00	384.00	384.00	344.00	365.00	313.00	344.00	327.00	272.00	320.00	289.00	265.00
310.00	310.00	395.00	395.00	344.00	360.00	341.00	341.00	325.00	294.00	297.00	297.00	265.00
320.00	320.00	413.00	329.00	292.00	292.00	294.00	277.00	277.00	275.00	313.00	289.00	255.00
330.00	330.00	401.00	401.00	348.00	287.00	287.00	282.00	262.00	223.00	301.00	277.00	243.00
340.00	340.00	390.00	392.00	127.00	282.00	282.00	282.00	282.00	248.00	192.00	262.00	238.00
350.00	350.00	393.00	325.00	289.00	291.00	275.00	275.00	250.00	294.00	294.00	265.00	213.00
360.00	360.00	381.00	332.00	284.00	284.00	286.00	265.00	286.00	218.00	296.00	267.00	218.00
370.00	370.00	377.00	337.00	260.00	291.00	291.00	291.00	291.00	221.00	296.00	270.00	233.00
380.00	380.00	400.00	339.00	301.00	296.00	279.00	248.00	213.00	292.00	292.00	262.00	203.00
390.00	390.00	395.00	395.00	322.00	296.00	296.00	282.00	223.00	301.00	291.00	277.00	243.00
400.00	400.00	400.00	322.00	289.00	289.00	289.00	289.00	291.00	291.00	294.00	267.00	206.00
410.00	410.00	395.00	325.00	289.00	301.00	284.00	284.00	284.00	298.00	289.00	265.00	238.00
420.00	420.00	402.00	332.00	275.00	289.00	282.00	282.00	243.00	197.00	300.00	265.00	245.00
430.00	430.00	430.00	327.00	327.00	301.00	298.00	279.00	250.00	211.00	291.00	291.00	206.00
440.00	440.00	400.00	387.00	327.00	296.00	275.00	275.00	252.00	213.00	293.00	293.00	206.00
450.00	450.00	450.00	395.00	395.00	301.00	282.00	248.00	211.00	296.00	271.00	243.00	203.00
460.00	460.00	460.00	395.00	322.00	289.00	289.00	289.00	289.00	294.00	294.00	267.00	245.00
470.00	470.00	398.00	398.00	337.00	275.00	294.00	289.00	289.00	201.00	294.00	260.00	230.00
480.00	480.00	395.00	379.00	327.00	277.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
490.00	490.00	400.00	398.00	327.00	275.00	275.00	275.00	275.00	203.00	293.00	272.00	243.00
500.00	500.00	500.00	395.00	395.00	301.00	284.00	284.00	284.00	203.00	293.00	272.00	243.00
510.00	510.00	510.00	398.00	398.00	329.00	275.00	275.00	275.00	203.00	293.00	272.00	243.00
520.00	520.00	520.00	395.00	395.00	331.00	275.00	275.00	275.00	203.00	293.00	272.00	243.00
530.00	530.00	530.00	398.00	398.00	331.00	275.00	275.00	275.00	201.00	294.00	272.00	243.00
540.00	540.00	540.00	395.00	395.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
550.00	550.00	550.00	398.00	398.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
560.00	560.00	560.00	395.00	395.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
570.00	570.00	570.00	398.00	398.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
580.00	580.00	580.00	395.00	395.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
590.00	590.00	590.00	398.00	398.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
600.00	600.00	600.00	395.00	395.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
610.00	610.00	610.00	398.00	398.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
620.00	620.00	620.00	395.00	395.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
630.00	630.00	630.00	398.00	398.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
640.00	640.00	640.00	395.00	395.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
650.00	650.00	650.00	398.00	398.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
660.00	660.00	660.00	395.00	395.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
670.00	670.00	670.00	398.00	398.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
680.00	680.00	680.00	395.00	395.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
690.00	690.00	690.00	398.00	398.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
700.00	700.00	700.00	395.00	395.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
710.00	710.00	710.00	398.00	398.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	243.00
720.00	720.00	720.00	395.00	395.00	327.00	277.00	277.00	277.00	201.00	294.00	272.00	

Table A-3. Experiment No. 2: Polypropylene Carpet (continued)

SECONDS	13	CHANNEL 14	15	16	17	18	19
-10.00	79.00	.00	.00	.00	.00	.00	.00
100.00	34.00	1371.98	990.17	623.28	911.66	983.92	.07
100.00	24.00	1371.98	678.54	593.35	711.77	756.60	.04
100.00	66.00	1371.98	821.57	603.49	800.79	915.38	.25
10.00	88.00	1371.98	814.19	510.89	899.57	893.76	.02
40.00	98.00	1371.98	836.25	577.54	810.82	898.36	.25
50.00	102.00	1371.98	766.29	587.95	814.84	881.87	.07
60.00	115.00	1371.98	787.67	582.77	793.26	874.78	.25
70.00	130.00	1371.98	757.85	533.84	778.55	860.00	.43
80.00	125.00	1319.93	816.11	522.64	798.67	882.45	.27
90.00	115.00	1319.93	781.95	397.65	745.60	860.99	.49
100.00	162.00	1319.93	743.67	577.80	777.06	848.87	.70
110.00	190.00	1319.93	738.85	455.76	748.43	853.64	1.03
120.00	203.00	1319.93	744.59	577.27	776.03	837.71	.70
130.00	213.00	1319.93	742.15	473.91	746.96	806.38	.94
140.00	225.00	1319.93	741.07	373.65	755.95	812.98	.99
150.00	233.00	1319.93	734.97	576.75	754.65	815.21	.85
160.00	235.00	1319.93	728.61	426.73	747.19	821.74	.99
170.00	238.00	1319.93	767.83	455.76	748.43	853.64	1.03
180.00	230.00	1319.93	747.02	577.54	762.97	832.59	.99
190.00	230.00	1319.93	742.15	347.49	723.24	812.98	1.03
200.00	233.00	1319.93	713.54	389.16	722.01	806.25	.85
210.00	216.00	1319.93	738.85	496.43	724.10	819.53	.99
220.00	218.00	* 1319.93	730.96	460.77	718.18	798.12	* 8R
230.00	218.00	1319.93	743.25	528.13	752.77	841.28	* 70
240.00	230.00	1319.93	707.85	504.92	737.73	792.21	* 90
250.00	213.00	1319.93	750.57	492.44	723.24	812.98	* 94
260.00	203.00	833.86	757.61	575.17	747.91	841.02	* 90
270.00	197.00	861.74	771.00	480.27	745.64	816.52	* 72
280.00	192.00	867.92	791.63	492.44	753.12	808.89	* 70
290.00	192.00	867.92	791.63	492.44	762.74	851.88	* 88
300.00	185.00	840.57	750.38	487.80	752.06	841.02	* 63
310.00	190.00	845.83	749.56	531.13	740.26	813.90	* 72
320.00	190.00	871.46	783.12	475.83	747.91	833.88	* 65
330.00	180.00	843.15	751.73	539.78	759.70	856.39	* 72
340.00	195.00	849.04	766.04	620.84	767.05	866.31	* 63
350.00	187.00	825.35	734.67	377.68	704.94	797.99	* 72
360.00	177.00	826.88	704.72	426.38	730.46	787.88	* 65
370.00	145.00	815.19	762.97	401.83	737.73	837.59	* 58
380.00	185.00	839.28	765.93	550.63	750.29	831.05	* 65
390.00	185.00	863.84	766.17	577.80	740.77	834.65	* 72
400.00	187.00	825.35	734.67	377.68	704.94	797.99	* 72
410.00	185.00	861.95	768.41	480.59	738.57	847.86	* 49
420.00	187.00	791.63	759.16	440.38	731.31	824.21	* 65
430.00	190.00	831.14	762.50	603.49	777.06	862.23	* 40
440.00	195.00	850.96	717.21	205.39	702.79	797.72	* 49
500.00	185.00	844.47	770.77	577.27	753.83	848.49	* 65
510.00	185.00	187.00	770.88	610.60	778.55	860.99	* 63
520.00	180.00	861.95	768.41	480.59	738.57	847.86	* 49
530.00	192.00	844.01	775.22	527.32	737.01	823.49	* 70
540.00	182.00	832.12	735.17	477.80	724.84	816.65	* 52
550.00	195.00	864.37	760.47	480.92	721.72	822.39	* 70
560.00	192.00	878.29	796.65	603.49	785.94	858.51	* 58
570.00	185.00	863.21	754.26	522.64	754.42	848.61	* 65
580.00	192.00	868.96	776.73	501.60	751.24	823.04	* 58
590.00	192.00	861.11	746.53	441.07	737.01	823.49	* 70
600.00	800.50	758.09	492.44	730.45	740.26	816.65	* 65
610.00	871.84	761.37	717.21	205.39	702.79	797.72	* 49
620.00	192.00	832.88	753.06	492.44	735.80	872.83	* 65
630.00	192.00	855.64	773.23	302.25	723.00	824.34	* 58
640.00	192.00	857.74	775.34	516.90	757.36	831.31	* 58
650.00	185.00	857.74	749.46	539.50	760.99	844.95	* 65
660.00	185.00	865.53	741.31	591.53	749.10	853.64	* 58
670.00	192.00	746.17	664.51	426.73	641.12	751.92	* 36

Table A-4. Experiment No. 3: Wool Carpet

SECONDS	1	CHANNEL IDENT.	2	3	4	5	6	7	8	9	10	11	12
-10.00	-12.00	41.00	34.00	32.00	34.00	32.00	32.00	32.00	32.00	32.00	32.00	32.00	32.00
0.00	17.00	17.00	17.00	22.00	29.00	93.00	68.00	175.00	170.00	170.00	170.00	17.00	17.00
10.00	10.00	211.00	150.00	150.00	152.00	197.00	147.00	83.00	210.00	190.00	145.00	110.00	73.00
20.00	20.00	327.00	265.00	211.00	252.00	235.00	177.00	78.00	250.00	225.00	177.00	150.00	120.00
30.00	30.00	388.00	313.00	240.00	277.00	272.00	235.00	201.00	145.00	265.00	238.00	195.00	157.00
40.00	40.00	414.00	339.00	277.00	393.00	310.00	296.00	223.00	155.00	282.00	265.00	218.00	172.00
50.00	50.00	480.00	400.00	345.00	344.00	346.00	327.00	243.00	177.00	305.00	275.00	230.00	201.00
60.00	60.00	521.00	493.00	454.00	329.00	341.00	317.00	260.00	167.00	301.00	279.00	240.00	192.00
70.00	70.00	70.00	498.00	416.00	317.00	322.00	301.00	287.00	270.00	177.00	29.00	270.00	235.00
80.00	80.00	90.00	466.00	393.00	322.00	294.00	284.00	245.00	162.00	296.00	277.00	225.00	195.00
90.00	90.00	100.00	435.00	348.00	265.00	286.00	286.00	235.00	192.00	265.00	265.00	221.00	180.00
100.00	100.00	110.00	419.00	370.00	287.00	315.00	286.00	250.00	185.00	289.00	270.00	223.00	190.00
110.00	110.00	120.00	428.00	372.00	287.00	301.00	295.00	245.00	195.00	284.00	255.00	216.00	192.00
120.00	120.00	130.00	456.00	360.00	301.00	359.00	315.00	267.00	192.00	305.00	282.00	250.00	213.00
130.00	130.00	140.00	561.00	475.00	396.00	372.00	315.00	287.00	221.00	353.00	317.00	277.00	243.00
140.00	140.00	150.00	591.00	617.00	428.00	486.00	398.00	381.00	389.00	389.00	355.00	315.00	282.00
150.00	160.00	568.00	669.00	512.00	615.00	471.00	509.00	440.00	245.00	428.00	500.00	475.00	365.00
160.00	170.00	528.00	591.00	596.00	636.00	636.00	617.00	553.00	272.00	566.00	523.00	395.00	310.00
170.00	180.00	561.00	629.00	629.00	616.00	645.00	616.00	365.00	591.00	279.00	580.00	600.00	502.00
180.00	190.00	563.00	615.00	542.00	216.00	610.00	600.00	388.00	532.00	272.00	535.00	580.00	531.00
190.00	200.00	488.00	554.00	554.00	255.00	255.00	605.00	375.00	502.00	332.00	492.00	542.00	454.00
200.00	210.00	480.00	545.00	561.00	561.00	561.00	627.00	279.00	393.00	291.00	559.00	610.00	491.00
210.00	220.00	509.00	582.00	275.00	634.00	348.00	500.00	348.00	500.00	332.00	596.00	615.00	424.00
220.00	230.00	559.00	523.00	573.00	135.00	667.00	667.00	492.00	320.00	553.00	582.00	566.00	442.00
230.00	240.00	523.00	580.00	155.00	645.00	356.00	491.00	322.00	566.00	593.00	582.00	514.00	391.00
240.00	250.00	533.00	538.00	605.00	152.00	678.00	301.00	493.00	310.00	535.00	610.00	555.00	391.00
250.00	260.00	480.00	498.00	598.00	130.00	669.00	279.00	431.00	317.00	542.00	605.00	493.00	363.00
260.00	270.00	510.00	580.00	127.00	641.00	294.00	402.00	277.00	570.00	554.00	624.00	538.00	368.00
270.00	280.00	507.00	559.00	115.00	669.00	291.00	360.00	294.00	568.00	570.00	615.00	495.00	377.00
280.00	290.00	507.00	561.00	127.00	612.00	301.00	360.00	292.00	568.00	568.00	660.00	629.00	414.00
290.00	300.00	523.00	561.00	127.00	619.00	287.00	363.00	282.00	580.00	565.00	552.00	577.00	388.00
300.00	310.00	510.00	556.00	157.00	648.00	292.00	384.00	292.00	570.00	570.00	686.00	568.00	409.00
310.00	320.00	521.00	624.00	140.00	160.00	566.00	313.00	365.00	296.00	580.00	681.00	593.00	426.00
320.00	330.00	502.00	624.00	127.00	521.00	289.00	360.00	360.00	591.00	612.00	709.00	626.00	416.00
330.00	340.00	493.00	629.00	127.00	626.00	514.00	291.00	360.00	284.00	563.00	683.00	714.00	414.00
340.00	350.00	494.00	626.00	142.00	502.00	282.00	358.00	358.00	582.00	582.00	702.00	577.00	393.00
350.00	360.00	521.00	648.00	142.00	502.00	282.00	358.00	358.00	582.00	582.00	660.00	655.00	552.00
360.00	370.00	501.00	634.00	157.00	442.00	270.00	346.00	270.00	565.00	565.00	702.00	549.00	389.00
370.00	380.00	505.00	559.00	155.00	405.00	265.00	320.00	267.00	561.00	561.00	712.00	573.00	375.00
380.00	390.00	507.00	535.00	152.00	405.00	260.00	310.00	270.00	566.00	566.00	704.00	488.00	356.00
390.00	400.00	493.00	505.00	155.00	405.00	260.00	313.00	270.00	562.00	562.00	603.00	512.00	360.00
400.00	410.00	545.00	498.00	130.00	395.00	252.00	320.00	267.00	591.00	591.00	716.00	431.00	332.00
410.00	420.00	521.00	475.00	160.00	387.00	262.00	315.00	275.00	580.00	580.00	660.00	407.00	332.00
420.00	430.00	570.00	545.00	147.00	442.00	384.00	260.00	303.00	262.00	569.00	569.00	648.00	393.00
430.00	440.00	504.00	493.00	142.00	384.00	260.00	303.00	284.00	292.00	292.00	615.00	619.00	379.00
440.00	450.00	561.00	452.00	125.00	360.00	257.00	289.00	289.00	284.00	284.00	593.00	375.00	322.00
450.00	460.00	498.00	447.00	155.00	360.00	248.00	296.00	270.00	287.00	287.00	615.00	593.00	317.00
460.00	470.00	545.00	440.00	147.00	368.00	248.00	298.00	252.00	282.00	282.00	603.00	512.00	365.00
470.00	480.00	480.00	435.00	152.00	358.00	265.00	329.00	235.00	289.00	289.00	600.00	498.00	313.00
480.00	490.00	490.00	426.00	132.00	358.00	267.00	284.00	284.00	292.00	292.00	596.00	456.00	353.00
490.00	500.00	500.00	426.00	125.00	360.00	260.00	260.00	292.00	292.00	292.00	445.00	353.00	305.00
500.00	510.00	478.00	409.00	147.00	340.00	235.00	284.00	284.00	272.00	272.00	449.00	386.00	329.00
510.00	520.00	498.00	414.00	142.00	346.00	270.00	289.00	289.00	280.00	280.00	384.00	353.00	310.00
520.00	530.00	530.00	468.00	144.00	155.00	351.00	248.00	287.00	287.00	346.00	346.00	334.00	298.00
530.00	540.00	540.00	358.00	132.00	329.00	235.00	289.00	289.00	240.00	240.00	341.00	337.00	308.00
540.00	550.00	550.00	393.00	160.00	348.00	243.00	243.00	243.00	243.00	243.00	353.00	353.00	279.00
550.00	560.00	560.00	459.00	135.00	320.00	245.00	245.00	245.00	245.00	245.00	353.00	353.00	284.00
560.00	570.00	570.00	407.00	120.00	353.00	267.00	287.00	287.00	287.00	287.00	341.00	341.00	282.00
570.00	580.00	580.00	468.00	149.00	185.00	368.00	272.00	289.00	289.00	289.00	341.00	341.00	303.00
580.00	590.00	590.00	387.00	167.00	356.00	270.00	289.00	289.00	289.00	289.00	341.00	341.00	303.00

Table A-4. Experiment No. 3: Wool Carpet (continued)

SECONDS	13	CHANNEL	IDENT.	14	15	16	17	18	19
-10.00	32.00	.00	.00	866.25	550.91	*.00	*.00	*.00	*.00
*.00	17.00	961.95	918.37	955.15	901.97	*.04	*.04	*.04	*.04
10.00	51.00	9n5.70	830.27	624.74	872.49	*.25	*.25	*.25	*.25
20.00	93.00	861.74	460.92	839.24	883.30	*.31	*.31	*.31	*.31
30.00	127.00	838.20	788.31	821.13	869.02	*.20	*.20	*.20	*.20
40.00	132.00	842.04	757.25	550.91	819.51	*.40	*.40	*.40	*.40
50.00	147.00	859.53	766.05	460.92	800.07	*.72	*.72	*.72	*.72
60.00	170.00	8n6.25	748.23	635.10	810.34	*.65	*.65	*.65	*.65
70.00	170.00	8n1.64	754.14	603.49	812.75	*.70	*.70	*.70	*.70
80.00	165.00	856.26	754.26	492.44	803.07	*.94	*.94	*.94	*.94
90.00	180.00	847.76	775.45	598.19	810.45	*.74	*.74	*.74	*.74
100.00	160.00	812.85	743.01	575.17	781.97	*.61	*.61	*.61	*.61
110.00	167.00	812.97	763.92	430.27	778.32	*.54	*.54	*.54	*.54
120.00	120.00	859.85	774.40	330.09	789.55	*.61	*.61	*.61	*.61
130.00	160.00	856.37	779.30	345.36	789.1	*.76	*.76	*.76	*.76
140.00	185.00	798.35	694.11	492.75	739.90	*.97	*.97	*.97	*.97
150.00	192.00	843.47	727.24	460.92	770.05	*.24	*.24	*.24	*.24
160.00	245.00	821.72	761.43	440.38	769.13	*.14	*.14	*.14	*.14
170.00	267.00	799.60	713.54	457.29	740.74	*.54	*.54	*.54	*.54
180.00	294.00	757.61	671.70	404.83	696.05	*.52	*.52	*.52	*.52
190.00	346.00	755.46	678.27	426.73	698.86	*.70	*.70	*.70	*.70
200.00	377.00	800.62	707.03	522.64	738.09	*.45	*.45	*.45	*.45
210.00	414.00	761.43	665.60	550.63	710.22	*.63	*.63	*.63	*.63
220.00	358.00	697.75	645.57	492.44	675.17	*.63	*.63	*.63	*.63
230.00	388.00	762.26	693.32	534.13	727.66	*.54	*.54	*.54	*.54
240.00	346.00	779.18	724.62	504.62	739.18	*.27	*.27	*.27	*.27
250.00	334.00	719.60	641.35	492.75	671.60	*.40	*.40	*.40	*.40
260.00	332.00	713.28	656.28	510.89	689.89	*.27	*.27	*.27	*.27
270.00	325.00	733.32	675.73	473.91	704.05	*.05	*.05	*.05	*.05
280.00	325.00	681.73	629.85	460.92	710.72	*.29	*.29	*.29	*.29
290.00	322.00	767.96	691.62	447.22	725.82	*.18	*.18	*.18	*.18
300.00	322.00	731.71	686.23	419.56	670.94	*.16	*.16	*.16	*.16
310.00	327.00	740.57	681.73	348.43	669.88	*.11	*.11	*.11	*.11
320.00	344.00	689.00	624.17	343.60	641.53	*.09	*.09	*.09	*.09
330.00	351.00	783.47	706.91	430.63	736.40	*.07	*.07	*.07	*.07
340.00	339.00	325.00	729.85	681.73	440.73	*.06	*.06	*.06	*.06
350.00	337.00	731.71	673.31	475.82	735.83	*.29	*.29	*.29	*.29
360.00	322.00	739.46	684.12	426.38	696.31	*.18	*.18	*.18	*.18
370.00	320.00	743.93	690.58	133.82	699.24	*.16	*.16	*.16	*.16
380.00	317.00	745.44	675.73	550.63	755.95	*.84	*.84	*.84	*.84
390.00	305.00	722.99	667.50	404.83	683.68	*.60	*.60	*.60	*.60
400.00	301.00	746.39	622.72	550.08	681.20	*.06	*.06	*.06	*.06
410.00	291.00	712.28	684.25	522.64	721.89	*.51	*.51	*.51	*.51
420.00	298.00	770.41	672.10	426.73	697.33	*.62	*.62	*.62	*.62
430.00	289.00	808.83	703.18	427.09	697.96	*.02	*.02	*.02	*.02
440.00	289.10	772.41	718.47	550.63	734.83	*.54	*.54	*.54	*.54
450.00	286.00	745.41	674.39	433.44	711.97	*.99	*.99	*.99	*.99
460.00	291.00	676.67	684.25	522.64	721.89	*.51	*.51	*.51	*.51
470.00	298.00	769.35	705.37	339.16	730.22	*.53	*.53	*.53	*.53
480.00	287.00	789.57	710.36	513.85	723.86	*.15	*.15	*.15	*.15
490.00	284.00	775.22	695.67	433.79	737.37	*.81	*.81	*.81	*.81
500.00	283.00	803.89	715.06	424.95	746.12	*.42	*.42	*.42	*.42
510.00	265.00	836.03	742.64	603.49	796.39	*.14	*.14	*.14	*.14
520.00	272.00	829.94	729.85	454.96	753.24	*.05	*.05	*.05	*.05
530.00	267.00	821.39	735.41	404.46	773.74	*.82	*.82	*.82	*.82
540.00	260.00	815.41	720.36	389.16	756.42	*.21	*.21	*.21	*.21
550.00	26.00	830.49	748.47	426.73	767.51	*.06	*.06	*.06	*.06
560.00	257.00	800.51	710.87	517.97	757.83	*.03	*.03	*.03	*.03
570.00	257.00	784.12	734.67	460.92	756.30	*.42	*.42	*.42	*.42
580.00	267.00	796.08	719.85	583.03	781.63	*.05	*.05	*.05	*.05
590.00	260.00	801.64	722.37	492.75	756.19	*.45	*.45	*.45	*.45

Table A-5. Experiment No. 4: Nylon Carpet

E 84 TEST NYLON W/PAD CEILING MOUNT												
SECONDS	CHANNEL 1DFNT.											
	1	2	3	4	5	6	7	8	9	10	11	12
-10.00	-10.00	27.00	29.00	37.00	32.00	34.00	27.00	27.00	27.00	27.00	27.00	27.00
.00	.00	29.00	46.00	37.00	19.00	112.00	29.00	32.00	32.00	32.00	32.00	29.00
10.00	10.00	291.00	238.00	155.00	140.00	152.00	112.00	51.00	206.00	145.00	125.00	88.00
20.00	20.00	308.00	255.00	187.00	201.00	122.00	147.00	105.00	218.00	197.00	147.00	122.00
30.00	30.00	353.00	277.00	197.00	233.00	195.00	170.00	117.00	240.00	211.00	170.00	142.00
40.00	40.00	34.00	277.00	203.00	733.00	185.00	167.00	120.00	243.00	216.00	167.00	132.00
50.00	50.00	348.00	284.00	199.00	225.00	190.00	177.00	107.00	218.00	170.00	170.00	140.00
60.00	60.00	356.00	297.00	238.00	223.00	200.00	180.00	122.00	252.00	199.00	152.00	152.00
70.00	70.00	363.00	317.00	298.00	250.00	211.00	182.00	125.00	260.00	233.00	180.00	150.00
80.00	80.00	389.00	317.00	228.00	252.00	230.00	197.00	132.00	277.00	257.00	200.00	162.00
90.00	90.00	393.00	320.00	243.00	228.00	206.00	152.00	105.00	255.00	203.00	175.00	175.00
100.00	100.00	424.00	346.00	277.00	289.00	252.00	225.00	165.00	289.00	267.00	218.00	180.00
110.00	110.00	449.00	368.00	294.00	298.00	270.00	248.00	185.00	303.00	287.00	240.00	199.00
120.00	120.00	523.00	454.00	377.00	344.00	305.00	294.00	221.00	337.00	315.00	275.00	225.00
130.00	130.00	561.00	428.00	491.00	419.00	372.00	317.00	245.00	360.00	344.00	301.00	242.00
140.00	140.00	523.00	596.00	464.00	520.00	414.00	370.00	286.00	372.00	325.00	289.00	289.00
150.00	150.00	521.00	615.00	478.00	552.00	449.00	384.00	303.00	395.00	332.00	286.00	286.00
160.00	160.00	507.00	598.00	505.00	561.00	454.00	387.00	332.00	407.00	391.00	346.00	305.00
170.00	170.00	547.00	603.00	540.00	561.00	435.00	353.00	353.00	431.00	426.00	372.00	328.00
180.00	180.00	526.00	612.00	652.00	627.00	526.00	471.00	387.00	475.00	480.00	424.00	366.00
190.00	190.00	528.00	629.00	593.00	646.00	629.00	509.00	402.00	475.00	495.00	459.00	389.00
200.00	200.00	533.00	615.00	521.00	676.00	549.00	612.00	505.00	464.00	498.00	498.00	451.00
210.00	210.00	521.00	570.00	655.00	655.00	547.00	669.00	593.00	449.00	480.00	466.00	466.00
220.00	220.00	512.00	559.00	626.00	634.00	664.00	686.00	714.00	438.00	459.00	440.00	454.00
230.00	230.00	600.00	589.00	686.00	667.00	745.00	700.00	726.00	442.00	461.00	438.00	451.00
240.00	240.00	605.00	605.00	719.00	683.00	726.00	671.00	712.00	442.00	473.00	452.00	478.00
250.00	250.00	667.00	643.00	701.00	681.00	724.00	664.00	688.00	459.00	493.00	468.00	496.00
260.00	260.00	603.00	596.00	641.00	644.00	655.00	641.00	629.00	480.00	500.00	480.00	522.00
270.00	270.00	573.00	596.00	624.00	634.00	619.00	631.00	596.00	475.00	507.00	488.00	549.00
280.00	280.00	570.00	596.00	643.00	659.00	656.00	622.00	622.00	545.00	570.00	545.00	631.00
290.00	290.00	566.00	657.00	519.00	714.00	531.00	608.00	495.00	526.00	570.00	598.00	702.00
300.00	300.00	547.00	547.00	629.00	466.00	712.00	533.00	570.00	484.00	533.00	580.00	617.00
310.00	310.00	561.00	636.00	402.00	707.00	482.00	477.00	414.00	531.00	493.00	468.00	496.00
320.00	320.00	580.00	580.00	387.00	719.00	452.00	554.00	407.00	533.00	617.00	676.00	750.00
330.00	330.00	549.00	643.00	332.00	671.00	433.00	502.00	387.00	549.00	631.00	702.00	755.00
340.00	340.00	533.00	638.00	638.00	650.00	393.00	471.00	337.00	668.00	660.00	716.00	644.00
350.00	350.00	559.00	671.00	303.00	631.00	379.00	464.00	317.00	612.00	702.00	724.00	645.00
360.00	360.00	559.00	652.00	270.00	593.00	593.00	412.00	301.00	626.00	583.00	709.00	605.00
370.00	370.00	570.00	667.00	294.00	612.00	320.00	345.00	298.00	643.00	683.00	676.00	601.00
380.00	380.00	570.00	696.00	275.00	568.00	270.00	358.00	277.00	624.00	662.00	662.00	545.00
390.00	390.00	568.00	667.00	270.00	502.00	301.00	393.00	282.00	570.00	650.00	596.00	482.00
400.00	400.00	545.00	676.00	278.00	507.00	298.00	407.00	308.00	668.00	667.00	641.00	464.00
410.00	410.00	586.00	622.00	275.00	468.00	308.00	379.00	287.00	566.00	643.00	568.00	426.00
420.00	420.00	545.00	575.00	250.00	456.00	279.00	360.00	327.00	275.00	568.00	683.00	559.00
430.00	430.00	497.00	540.00	267.00	433.00	275.00	353.00	275.00	596.00	702.00	528.00	398.00
440.00	440.00	573.00	528.00	270.00	416.00	272.00	358.00	277.00	566.00	662.00	662.00	545.00
450.00	450.00	554.00	488.00	255.00	412.00	284.00	325.00	282.00	600.00	650.00	596.00	482.00
460.00	460.00	498.00	452.00	270.00	388.00	279.00	325.00	260.00	619.00	619.00	461.00	377.00
470.00	470.00	466.00	426.00	262.00	377.00	337.00	287.00	270.00	615.00	526.00	402.00	356.00
480.00	480.00	464.00	440.00	270.00	382.00	287.00	327.00	317.00	555.00	471.00	372.00	339.00
490.00	490.00	452.00	405.00	267.00	363.00	275.00	313.00	257.00	596.00	570.00	327.00	315.00
500.00	500.00	464.00	438.00	270.00	379.00	270.00	317.00	270.00	438.00	389.00	346.00	348.00
510.00	510.00	510.00	412.00	265.00	412.00	277.00	320.00	262.00	600.00	619.00	461.00	377.00
520.00	520.00	456.00	412.00	248.00	364.00	272.00	317.00	265.00	643.00	438.00	332.00	313.00
530.00	530.00	435.00	414.00	243.00	243.00	175.00	282.00	270.00	270.00	379.00	360.00	298.00
540.00	540.00	447.00	419.00	257.00	360.00	275.00	313.00	257.00	255.00	437.00	360.00	310.00
550.00	550.00	438.00	393.00	248.00	360.00	275.00	313.00	275.00	379.00	389.00	346.00	348.00
560.00	560.00	424.00	377.00	267.00	379.00	270.00	317.00	262.00	379.00	388.00	334.00	334.00
570.00	570.00	424.00	393.00	230.00	348.00	265.00	296.00	248.00	363.00	377.00	337.00	301.00
580.00	580.00	446.00	416.00	248.00	372.00	315.00	315.00	260.00	363.00	351.00	315.00	289.00
590.00	590.00	431.00	391.00	262.00	363.00	310.00	310.00	260.00	363.00	344.00	311.00	298.00

Table A-5. Experiment No. 4: Nylon Carpet (continued)

SECONDS	13	CHANFL INFNT.	14	15	16	17	18	19
-10.00	27.00	.00	843.58	569.21	.00	923.97	937.65	.00
*00	29.00	964.96	788.08	433.79	a50.50	a91.61	a91.61	*00
10.00	48.00	912.28	785.78	444.29	a70.74	a92.92	a92.92	*20
20.00	90.00	888.44	785.20	546.76	a31.15	a82.04	a82.04	*22
30.00	107.00	855.20	749.20	561.55	a32.32	a69.88	a69.88	*22
40.00	110.00	823.00	758.09	527.06	a45.47	a76.37	a76.37	*25
50.00	115.00	880.76	772.06	527.06	a45.47	a76.37	a76.37	*31
60.00	117.00	844.07	764.39	457.62	a25.99	a67.47	a67.47	*36
70.00	120.00	876.23	776.62	258.40	a19.83	a42.55	a42.55	*36
80.00	130.00	851.49	747.99	448.42	a17.20	a47.35	a47.35	*45
90.00	137.00	850.45	752.94	469.41	a13.85	a46.22	a46.22	*45
100.00	142.00	845.08	715.44	401.73	a20.05	a49.87	a49.87	*54
110.00	165.20	854.35	740.57	173.34	781.52	817.31	817.31	*63
120.00	190.00	816.07	716.07	505.94	842.93	842.93	842.93	*85
130.00	225.00	823.81	723.37	321.23	766.47	786.38	786.38	*06
140.00	252.00	789.11	684.91	357.46	756.18	778.87	778.87	*35
150.00	257.00	787.96	703.31	400.38	770.74	803.19	803.19	*45
160.00	267.00	749.08	650.04	492.44	733.26	761.95	761.95	*57
170.00	291.00	791.23	674.25	359.15	727.90	767.82	767.82	*75
180.00	329.00	789.08	668.86	505.52	735.68	750.29	750.29	*87
190.00	346.00	714.30	645.87	393.04	715.33	731.67	731.67	*07
200.00	405.00	744.10	670.62	426.73	717.57	741.62	741.62	*35
210.00	431.00	770.65	649.61	389.55	716.70	761.97	761.97	*64
220.00	416.00	721.99	612.75	461.25	742.62	742.62	742.62	*65
230.00	431.00	714.42	623.59	460.92	697.33	709.35	709.35	*10
240.00	447.00	685.84	595.67	373.65	662.00	677.92	677.92	*39
250.00	468.00	713.16	609.94	388.18	680.68	695.05	695.05	*65
260.00	507.00	726.99	678.51	280.37	673.45	700.26	700.26	*14
270.00	526.00	726.99	609.20	294.11	680.55	709.20	709.20	*39
280.00	600.00	711.88	597.18	460.92	691.20	740.17	740.17	*94
290.00	636.00	717.33	426.06	398.86	672.79	719.08	719.08	*79
300.00	664.00	740.93	655.59	492.94	715.95	754.05	754.05	*99
310.00	750.00	709.72	614.23	533.84	706.95	725.59	725.59	*79
320.00	774.00	669.81	606.07	490.59	586.92	715.21	715.21	*79
330.00	823.00	675.33	604.21	352.32	451.98	711.61	711.61	*63
340.00	714.00	684.52	591.24	397.77	630.49	672.22	672.22	*43
350.00	712.00	676.57	593.23	550.83	672.79	719.08	719.08	*79
360.00	589.00	678.00	615.11	339.60	495.54	719.23	719.23	*99
370.00	552.00	677.60	612.75	550.63	696.56	745.21	745.21	*93
380.00	500.00	684.65	593.23	348.43	643.61	693.51	693.51	*69
390.00	454.00	692.41	618.20	404.83	651.98	682.63	682.63	*48
400.00	407.00	748.96	689.53	348.43	704.18	736.85	736.85	*39
410.00	384.00	690.97	676.57	550.83	672.79	719.08	719.08	*79
420.00	315.00	711.76	671.12	426.73	609.75	645.28	645.28	*27
430.00	346.00	742.89	650.74	398.79	687.70	742.62	742.62	*19
440.00	346.00	720.61	627.36	365.43	673.59	727.65	727.65	*24
450.00	334.00	716.58	629.81	522.64	688.73	736.85	736.85	*21
460.00	320.00	683.85	615.26	353.61	676.75	704.21	704.21	*06
470.00	315.00	697.62	594.14	516.80	674.77	713.26	713.26	*97
480.00	310.00	748.96	674.92	493.06	753.59	795.44	795.44	*85
490.00	298.00	762.26	676.13	389.16	740.74	785.29	785.29	*81
500.00	291.00	806.03	715.18	522.64	747.97	802.39	802.39	*85
510.00	298.00	799.83	676.53	534.13	743.73	806.11	806.11	*97
520.00	291.00	764.99	687.55	391.49	738.33	771.29	771.29	*88
530.00	294.00	808.39	685.05	498.57	760.87	803.46	803.46	*90
540.00	290.00	769.83	666.14	430.27	725.33	742.62	742.62	*85
550.00	287.00	773.23	671.70	493.06	753.59	795.44	795.44	*97
560.00	287.00	806.03	715.18	522.64	747.97	802.39	802.39	*81
570.00	279.00	767.94	676.53	534.13	743.73	806.11	806.11	*97
580.00	279.00	761.07	682.53	492.13	755.60	795.30	795.30	*81
590.00	275.00	770.53	691.23	465.97	742.66	787.33	787.33	*85
590.00	287.00	794.95	722.62	473.59	764.37	795.30	795.30	*79

E-84 N-3 NYLON W/PAD FLOOR MOUNT

Table A-6. Experiment No. 5: Nylon Carpet (Floor Mount)

L.C. (in.)	C (in./in.F°)	T (°F)	1	2	3	4	5	6	7	8	9	10	11	12	
-10.00	-10.00	34.00	54.00	10.00	107.00	1332.00	34.00	74.00	56.00	74.00	34.00	74.00	34.00	74.00	
.00	.00	41.00	46.00	34.00	29.00	387.00	41.00	41.00	34.00	34.00	34.00	34.00	34.00	34.00	
10.00	10.00	296.00	272.00	291.00	61.00	879.00	1422.00	213.00	132.00	243.00	218.00	197.00	150.00	102.00	
20.00	20.00	315.00	296.00	284.00	63.00	466.00	1073.00	213.00	152.00	250.00	223.00	197.00	162.00	107.00	
30.00	30.00	315.00	279.00	279.00	76.00	334.00	1205.00	211.00	155.00	268.00	225.00	197.00	170.00	107.00	
40.00	40.00	310.00	296.00	296.00	76.00	315.00	1205.00	216.00	162.00	248.00	225.00	197.00	177.00	107.00	
50.00	50.00	313.00	299.00	295.00	85.00	209.00	1205.00	218.00	175.00	255.00	230.00	199.00	175.00	107.00	
60.00	60.00	70.00	325.00	308.00	93.00	296.00	1205.00	235.00	182.00	257.00	235.00	206.00	180.00	106.00	
80.00	80.00	80.00	327.00	322.00	98.00	279.00	1252.00	238.00	190.00	262.00	240.00	208.00	182.00	102.00	
90.00	90.00	90.00	346.00	317.00	98.00	267.00	1252.00	235.00	170.00	262.00	245.00	213.00	187.00	107.00	
100.00	100.00	100.00	332.00	313.00	90.00	260.00	1260.00	248.00	192.00	272.00	257.00	221.00	195.00	105.00	
110.00	110.00	110.00	356.00	353.00	117.00	279.00	1260.00	272.00	218.00	277.00	267.00	231.00	205.00	105.00	
120.00	120.00	120.00	368.00	368.00	140.00	282.00	1260.00	292.00	216.00	284.00	272.00	240.00	216.00	106.00	
130.00	130.00	130.00	375.00	375.00	142.00	262.00	1260.00	310.00	248.00	292.00	277.00	252.00	225.00	106.00	
140.00	140.00	140.00	387.00	387.00	147.00	270.00	1248.00	303.00	250.00	292.00	277.00	260.00	228.00	106.00	
150.00	150.00	150.00	393.00	402.00	172.00	277.00	1248.00	351.00	260.00	298.00	289.00	267.00	255.00	106.00	
160.00	160.00	160.00	424.00	438.00	195.00	277.00	1248.00	368.00	310.00	303.00	291.00	275.00	265.00	106.00	
170.00	170.00	170.00	475.00	461.00	247.00	287.00	1228.00	428.00	325.00	313.00	308.00	296.00	272.00	106.00	
180.00	180.00	180.00	533.00	585.00	486.00	257.00	1038.00	475.00	428.00	551.00	351.00	318.00	315.00	106.00	
190.00	190.00	190.00	523.00	518.00	475.00	225.00	1260.00	310.00	248.00	529.00	351.00	318.00	315.00	106.00	
200.00	200.00	200.00	512.00	512.00	482.00	225.00	898.00	473.00	426.00	544.00	344.00	316.00	316.00	106.00	
210.00	210.00	210.00	545.00	573.00	448.00	223.00	872.00	502.00	454.00	563.00	360.00	339.00	327.00	106.00	
220.00	220.00	220.00	542.00	575.00	498.00	225.00	772.00	520.00	484.00	565.00	365.00	341.00	317.00	106.00	
230.00	230.00	230.00	538.00	563.00	523.00	233.00	757.00	509.00	459.00	579.00	375.00	356.00	325.00	106.00	
240.00	240.00	240.00	533.00	568.00	29.00	29.00	20.00	29.00	29.00	29.00	29.00	29.00	29.00	106.00	
250.00	250.00	250.00	549.00	582.00	514.00	265.00	728.00	502.00	491.00	490.00	409.00	405.00	363.00	106.00	
260.00	260.00	260.00	554.00	575.00	515.00	268.00	866.00	556.00	493.00	492.00	426.00	409.00	378.00	106.00	
270.00	270.00	270.00	568.00	582.00	523.00	344.00	624.00	556.00	498.00	492.00	442.00	435.00	396.00	106.00	
280.00	280.00	280.00	593.00	629.00	500.00	203.00	570.00	570.00	502.00	474.00	454.00	402.00	402.00	106.00	
290.00	290.00	290.00	568.00	568.00	596.00	365.00	521.00	605.00	523.00	478.00	473.00	462.00	462.00	106.00	
300.00	300.00	300.00	561.00	613.00	556.00	382.00	500.00	590.00	526.00	475.00	475.00	469.00	459.00	428.00	
310.00	310.00	310.00	547.00	582.00	612.00	421.00	421.00	610.00	538.00	491.00	495.00	486.00	459.00	427.00	
320.00	320.00	320.00	526.00	547.00	616.00	456.00	449.00	590.00	547.00	448.00	488.00	452.00	452.00	427.00	
330.00	330.00	330.00	500.00	549.00	641.00	678.00	419.00	573.00	591.00	466.00	475.00	573.00	521.00	427.00	
340.00	340.00	340.00	498.00	498.00	650.00	545.00	616.00	563.00	615.00	493.00	255.00	596.00	545.00	427.00	
350.00	350.00	350.00	568.00	608.00	582.00	452.00	542.00	542.00	542.00	547.00	603.00	677.00	603.00	427.00	
360.00	360.00	360.00	580.00	655.00	521.00	-21.00	779.00	550.00	568.00	712.00	657.00	414.00	414.00	365.00	
370.00	370.00	370.00	589.00	589.00	714.00	509.00	-202.00	972.00	533.00	500.00	752.00	645.00	473.00	427.00	
380.00	380.00	380.00	784.00	784.00	643.00	568.00	-549.00	157.00	541.00	498.00	488.00	452.00	377.00	365.00	
390.00	390.00	390.00	438.00	438.00	170.00	664.00	235.00	-151.00	619.00	573.00	466.00	475.00	387.00	365.00	
400.00	400.00	400.00	430.00	430.00	669.00	591.00	-676.00	1570.00	512.00	243.00	685.00	786.00	377.00	366.00	
410.00	410.00	410.00	712.00	629.00	629.00	-747.00	1276.00	544.00	542.00	614.00	660.00	787.00	377.00	366.00	
420.00	420.00	420.00	702.00	628.00	32.00	-895.00	1276.00	550.00	568.00	712.00	657.00	787.00	377.00	366.00	
430.00	430.00	430.00	975.00	728.00	571.00	-2927.00	228.00	449.00	533.00	500.00	752.00	645.00	473.00	427.00	
440.00	440.00	440.00	39.00	387.00	605.00	-32.00	-176.00	1338.00	1908.00	1045.00	1045.00	674.00	687.00	366.00	
450.00	450.00	450.00	489.00	1120.00	650.00	-17686.00	867.00	2298.00	317.00	464.00	464.00	638.00	636.00	466.00	
460.00	460.00	460.00	61.00	372.00	74.00	500.00	-52.00	32.00	523.00	523.00	523.00	523.00	32.00	32.00	
470.00	470.00	470.00	1075.00	528.00	-9174.00	284.00	-1276.00	296.00	282.00	500.00	523.00	523.00	523.00	32.00	
480.00	480.00	480.00	-371.00	294.00	1351.00	-952.00	-287.00	1572.00	1101.00	498.00	521.00	615.00	615.00	32.00	
490.00	490.00	490.00	-5.00	461.00	83.00	-34.00	-283.00	115.00	1039.00	468.00	514.00	514.00	514.00	32.00	
500.00	500.00	500.00	395.00	34.00	724.00	4361.00	-1623.00	-867.00	1047.00	531.00	408.00	547.00	547.00	32.00	
510.00	510.00	510.00	32.00	1010.00	650.00	-4667.00	867.00	2298.00	452.00	523.00	605.00	615.00	596.00	32.00	
520.00	520.00	520.00	37.00	449.00	952.00	76.00	-299.00	1854.00	1161.00	507.00	523.00	615.00	615.00	604.00	
530.00	530.00	530.00	-73.00	402.00	402.00	-1475.00	-3664.00	6335.00	2132.00	428.00	500.00	656.00	656.00	521.00	
540.00	540.00	540.00	-2187.00	-498.00	1351.00	-952.00	-23070.00	1255.00	1255.00	498.00	498.00	521.00	521.00	427.00	
550.00	550.00	550.00	550.00	228.00	20.00	-52.00	-1651.00	1837.00	-145.00	-651.00	724.00	641.00	631.00	427.00	
560.00	560.00	560.00	259.00	260.00	-1471.00	230.00	-1471.00	2029.00	10316.00	-315.00	-174.00	608.00	501.00	501.00	427.00
570.00	570.00	570.00	1803.00	1803.00	1601.00	32.00	-616.00	280.00	10697.00	15.00	51.00	51.00	51.00	503.00	427.00
580.00	580.00	580.00	590.00	1534.00	-919.00	255.00	-919.00	1805.00	10083.00	243.00	353.00	1029.00	830.00	120.00	427.00
590.00	590.00	590.00	600.00	1729.00	375.00	27	1934.00	7830.00	360.00	125.00	1640.00	1042.00	120.00	427.00	
600.00	600.00	600.00	610.00	1169.00	262.00	34	194.00	1934.00	360.00	405.00	1311.00	974.00	233.00	427.00	

Table A-6. Experiment No. 5: Nylon Carpet (Floor Mount) (continued)

SECONDS	CHANFL IDFNT.					17	18
	13	14	15	16			
-10.00	74.00	929.59	884.66	573.84	.00	.00	.00
0.00	74.00	929.59	884.66	573.84	.00	.00	.00
10.00	63.00	A14.19	764.99	556.12	829.69	A42.19	866.44
20.00	132.00	A71.88	777.78	550.91	829.73	A77.07	871.54
30.00	160.00	A38.74	737.26	440.73	816.90	A32.21	889.32
40.00	822.00	822.09	775.10	473.59	813.74		
50.00	145.00	A81.00	761.67	454.29	780.54	A51.54	851.54
60.00	150.00	A34.00	744.26	522.35	816.79	A51.76	829.22
70.00	160.00	784.85	721.49	510.60	767.96	A05.37	804.91
80.00	160.00	A33.97	730.22	545.57	766.93	A43.69	856.26
90.00	167.00	A85.83	773.23	492.44	824.27	A56.26	
100.00	170.00	827.65	717.71	427.80	788.65		
110.00	182.00	785.08	723.81	572.52	788.18		
120.00	192.00	A49.57	737.62	548.98	792.25	A37.07	
130.00	200.00	794.15	712.14	498.57	766.93	A05.82	
140.00	206.00	753.90	680.67	548.21	762.04	796.44	
150.00	235.00	782.66	689.00	301.75	747.07		
160.00	252.00	782.54	667.50	347.99	783.66		
170.00	265.00	780.34	680.93	503.11	720.51		
180.00	294.00	793.92	680.00	105.97	718.56		
190.00	294.00	757.01	666.78	467.14	724.10		
200.00	3n5.00	717.46	646.57	505.22	717.32		
210.00	305.00	756.53	646.97	134.94	679.89		
220.00	313.00	761.31	643.46	341.03	713.34		
230.00	317.00	759.04	691.62	726.70	778.78		
240.00	29.00	370.77	304.44	.00	326.67		
250.00	332.00	695.41	586.78	301.75	660.12		
260.00	346.00	729.60	647.95	504.92	696.69		
270.00	368.00	730.96	647.39	492.44	741.18		
280.00	389.00	721.36	637.24	310.67	765.72		
290.00	386.00	759.40	650.74	546.48	722.51		
300.00	388.00	745.68	650.32	426.38	713.56		
310.00	416.00	692.41	618.20	428.51	675.69		
320.00	402.00	631.53	591.39	315.99	646.92		
330.00	395.00	737.13	642.34	492.75	600.87		
340.00	442.00	728.61	637.10	432.39	756.60		
350.00	545.00	735.17	619.66	390.76	700.00		
360.00	596.00	741.42	650.04	440.73	681.20		
370.00	662.00	784.74	645.57	345.36	704.68		
380.00	29.00	370.77	304.44	.00	326.67		
390.00	471.00	705.32	635.82	492.44	608.09		
400.00	764.00	737.38	628.66	315.99	678.58		
410.00	741.00	722.57	641.35	463.82	715.54		
420.00	736.00	741.42	677.07	350.55	715.54		
430.00	740.00	741.00	642.76	447.22	709.34		
440.00	402.00	678.27	627.36	471.59	685.23		
450.00	505.00	683.85	606.81	320.76	678.06		
460.00	32.00	370.77	304.44	.00	326.67		
470.00	610.00	698.01	625.48	426.73	681.33		
480.00	535.00	709.72	501.85	460.92	680.88		
490.00	549.00	670.48	501.39	.00	326.67		
500.00	615.00	719.73	636.53	424.24	681.85		
510.00	573.00	666.99	570.03	426.38	634.00		
520.00	559.00	732.20	628.37	343.00	678.95		
530.00	495.00	717.71	612.06	325.46	629.58		
540.00	442.00	719.10	625.62	427.09	681.15		
550.00	862.00	677.60	581.69	313.58	678.84		
560.00	874.00	722.87	637.10	404.83	604.00		
570.00	745.00	683.85	586.94	426.73	655.38		
580.00	1041.00	724.87	645.43	408.47	671.18		
590.00	1227.00	680.93	612.75	440.38	672.26		
600.00	1739.00	749.08	640.77	339.60	600.37		
610.00	596.00	732.33	604.09	508.19	752.29		

APPENDIX B. SI CONVERSION UNITS

In view of present accepted practice in this technological area, U.S. customary units of measurement have been used throughout this report. It should be noted that the U.S. is a signatory to the General Conference on Weights and Measures which gave official status to the metric SI system of SI units in 1960. Readers interested in making use of the coherent system of SI units will find conversion factors in ASTM Standard Metric Practice Guide, ASTM Designation E 380-72 (available from American Society for Testing and Materials, 1916 Race Street, Philadelphia, Pennsylvania 19103). Conversion factors for units used in this paper are:

Length

$$1 \text{ in} = 0.0254^* \text{ meter}$$

$$1 \text{ ft} = 0.3048^* \text{ meter}$$

Area

$$1 \text{ in}^2 = 6.4516^* \times 10^{-4} \text{ meter}^2$$

$$1 \text{ ft}^2 = 9.2903 \times 10^{-2} \text{ meter}^2$$

Mass

$$1 \text{ lb} = 0.454 \text{ kg}$$

Pressure

$$1 \text{ in of H}_2\text{O} = 248.8 \text{ Pa}$$

Energy

$$1 \text{ Btu} = 1054 \text{ J}$$

Temperature

$$^{\circ}\text{C} = 5/9 (\text{Temperature } ^{\circ}\text{F} - 32)$$

Power

$$1 \text{ Btu/min} = 17.57 \text{ W}$$

*Exact Value

E-84 INSTRUMENTATION (NOT TO SCALE)

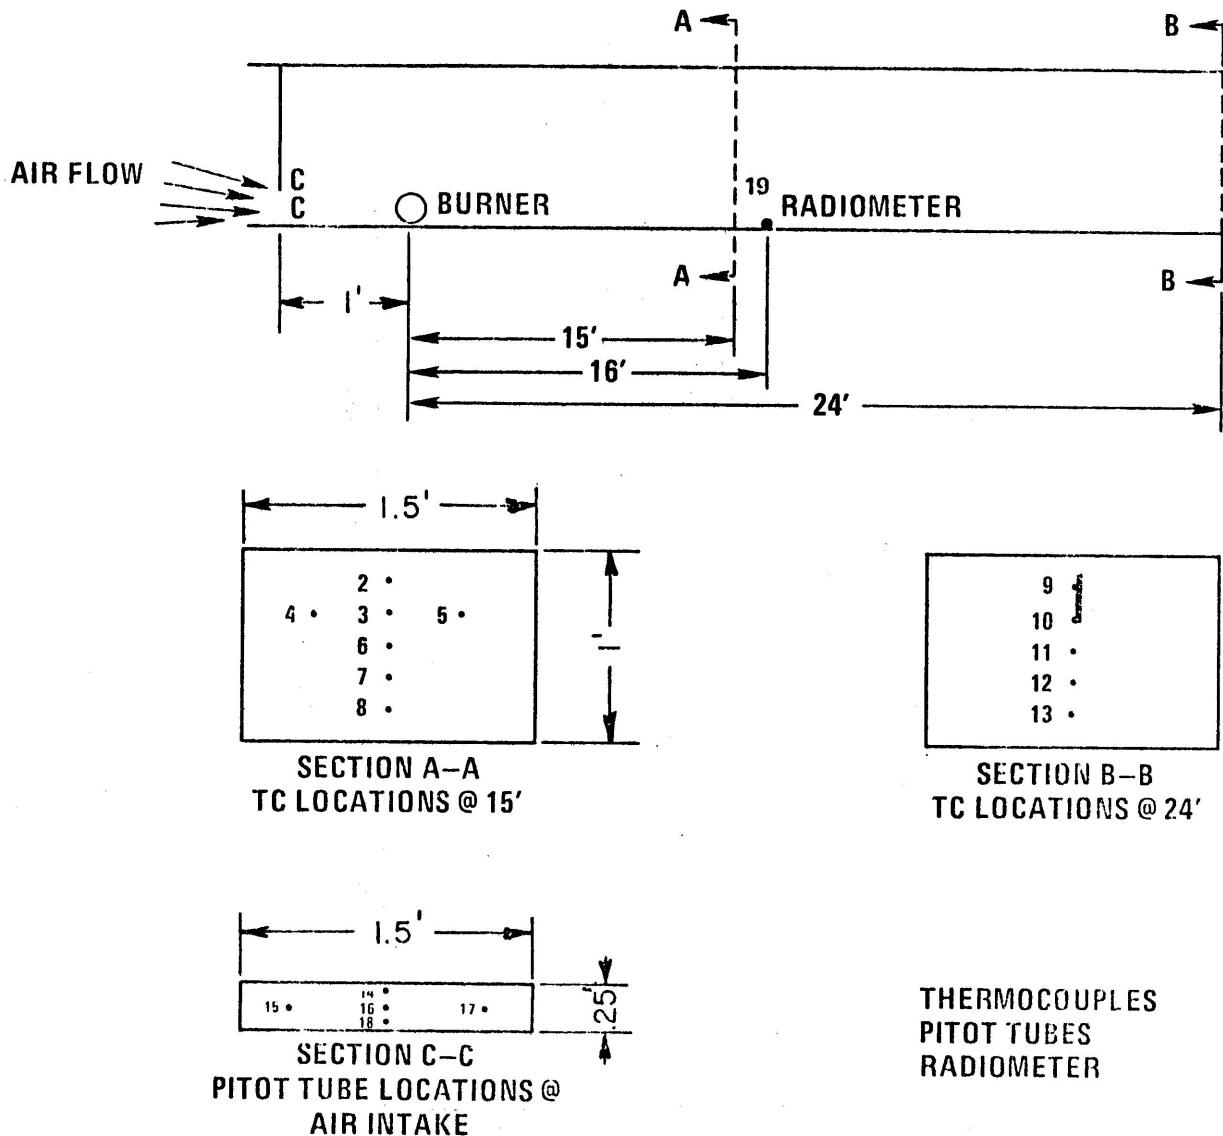


Figure 1. Schematic of instrumentation. (1 in = 0.0254 m,
1 ft = 0.3048m).

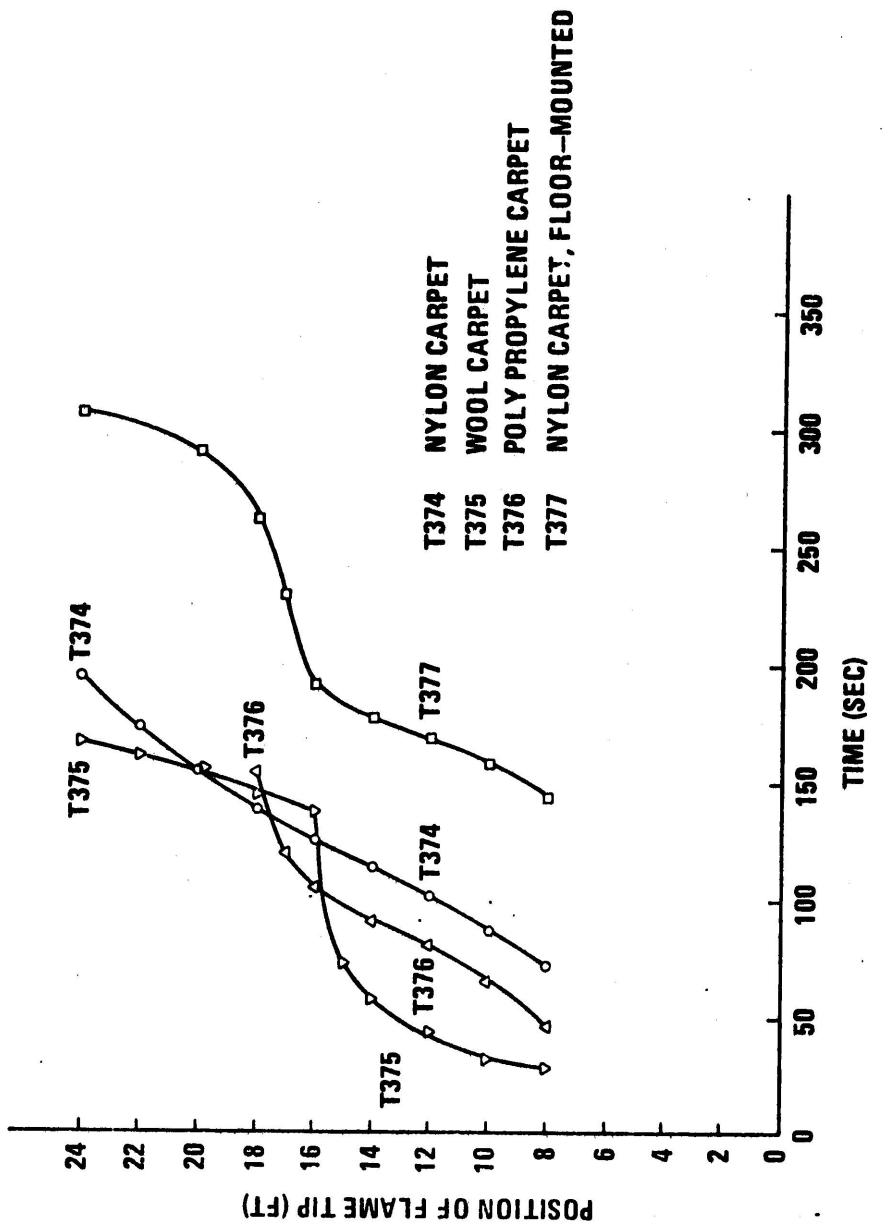


Figure 2. Flame tip position as a function of time. (1 ft = 0.3048 m).

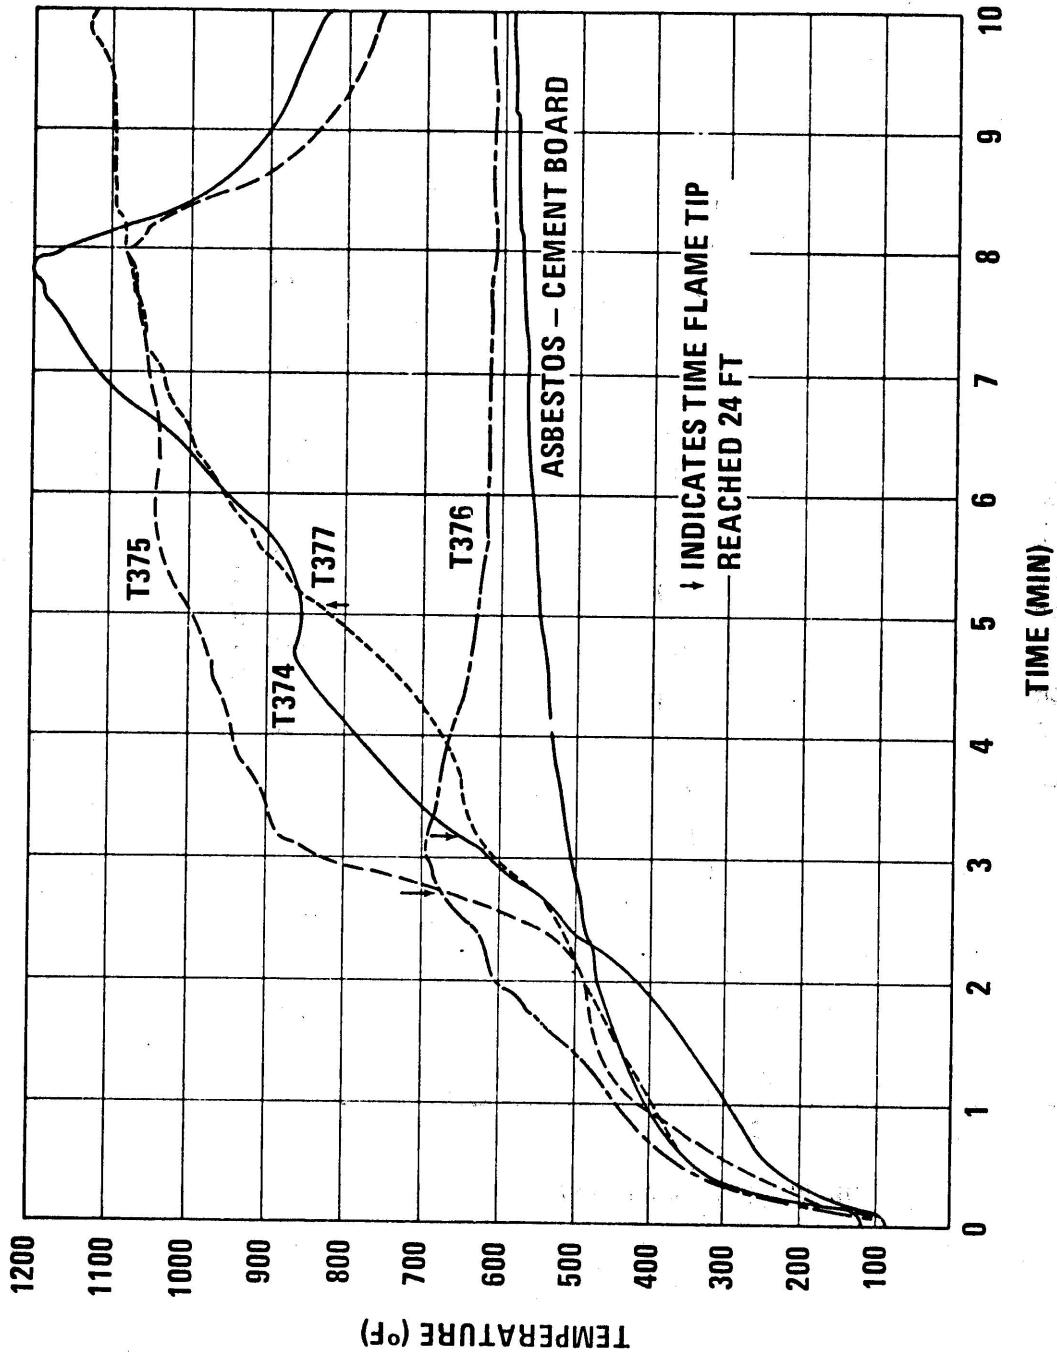


Figure 3. Exit gas temperature as determined in the standard test for an energy release rating.

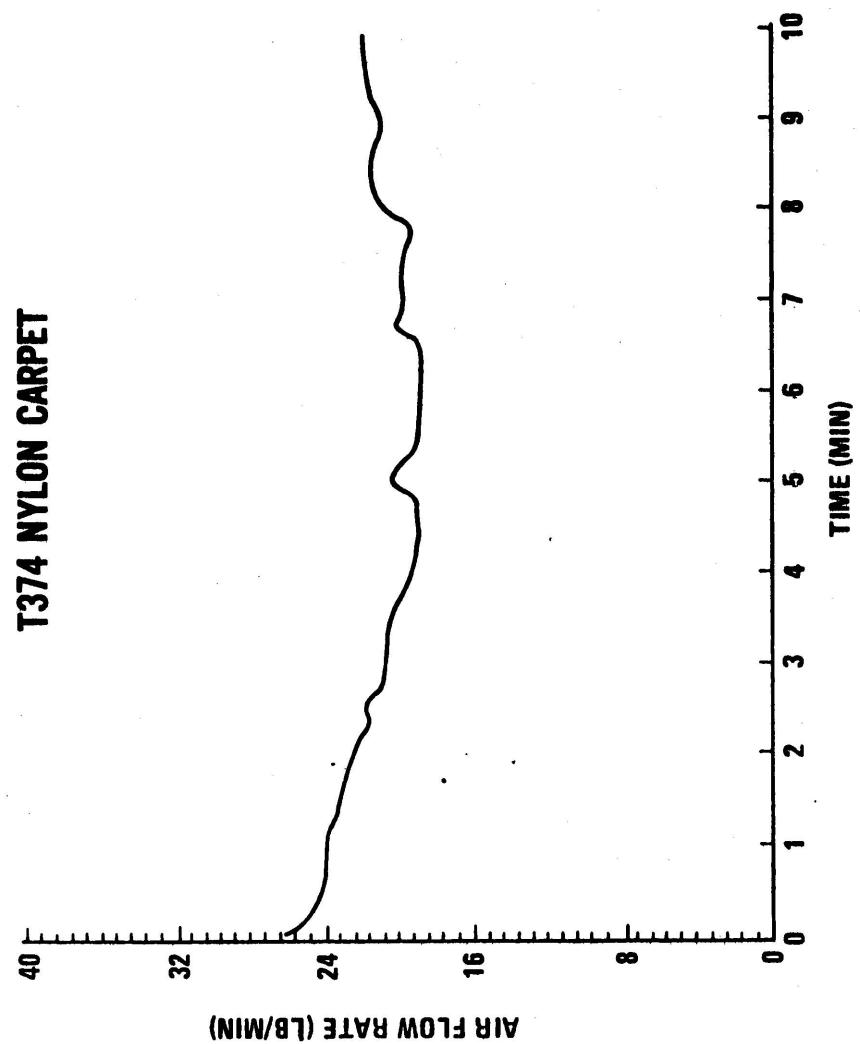


Figure 4a. Air mass flow rate for T374, nylon carpet.
(1 lb/min = 0.00756 kg/s)

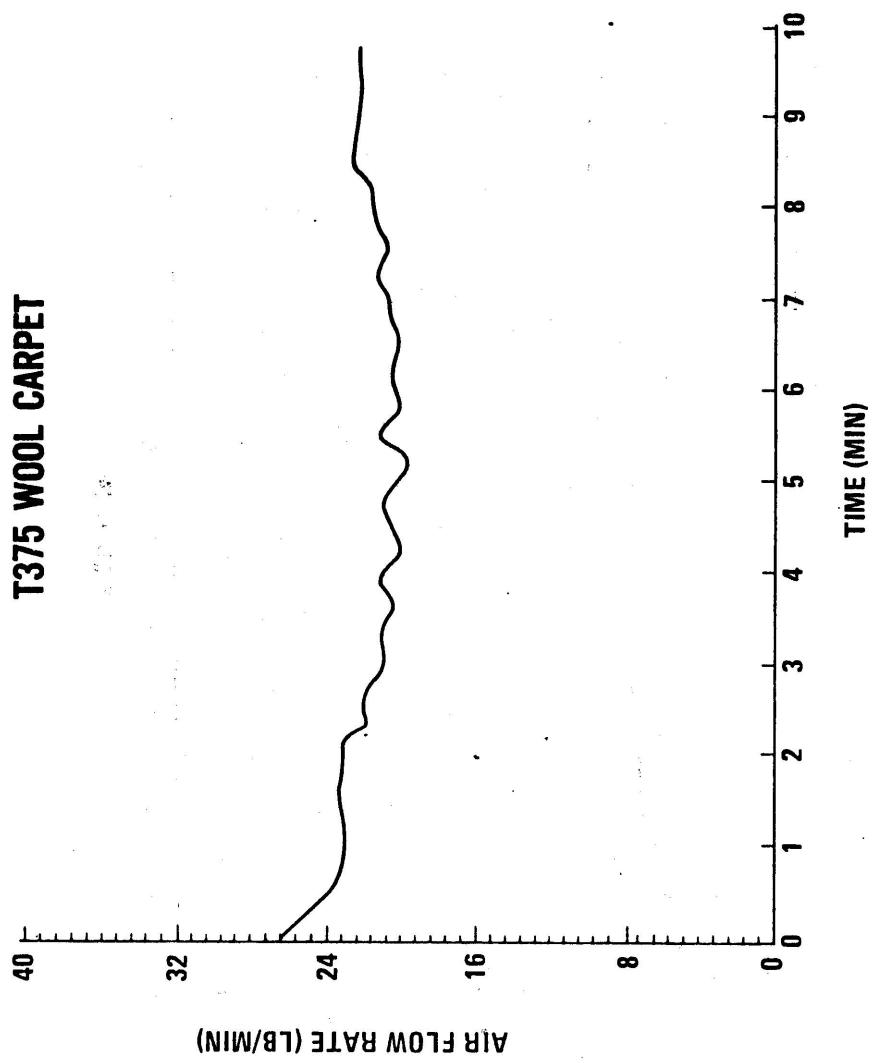


Figure 4b. Air mass flow rate for T375, wool carpet.
(1 lb/min = 0.00756 kg/s)

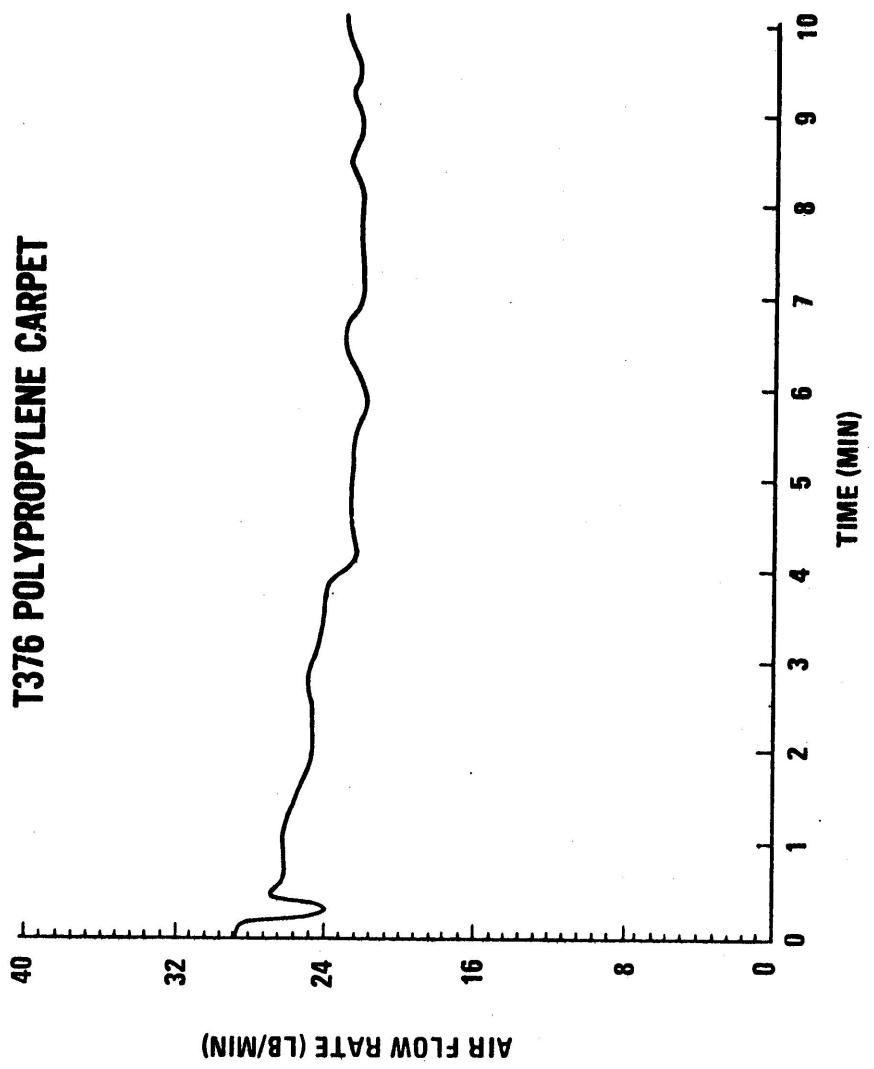


Figure 4c. Air mass flow rate for T376, polypropylene carpet.
(1 lb/min = 0.00756 kg/s)

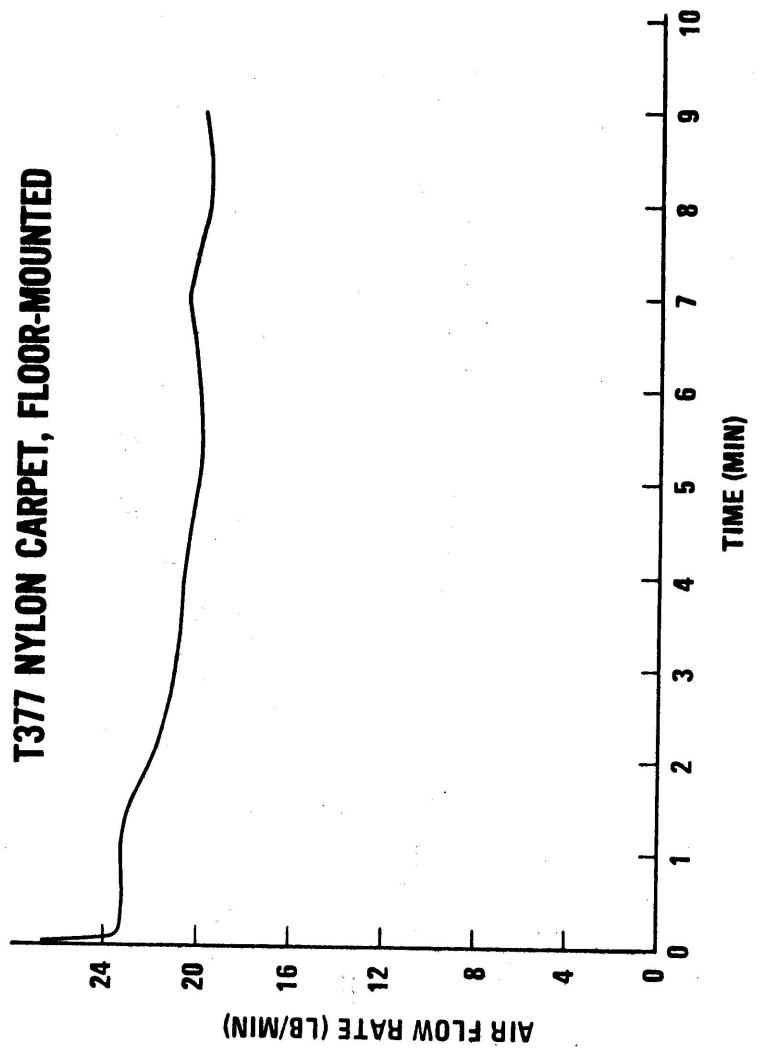


Figure 4d. Air mass flow rate for T377, Nylon carpet (floor mounted).
(1 lb/min = 0.00756 kg/s)

**CALIBRATION-ASBESTOS CEMENT BOARD
CONVECTIVE ENERGY AT A**

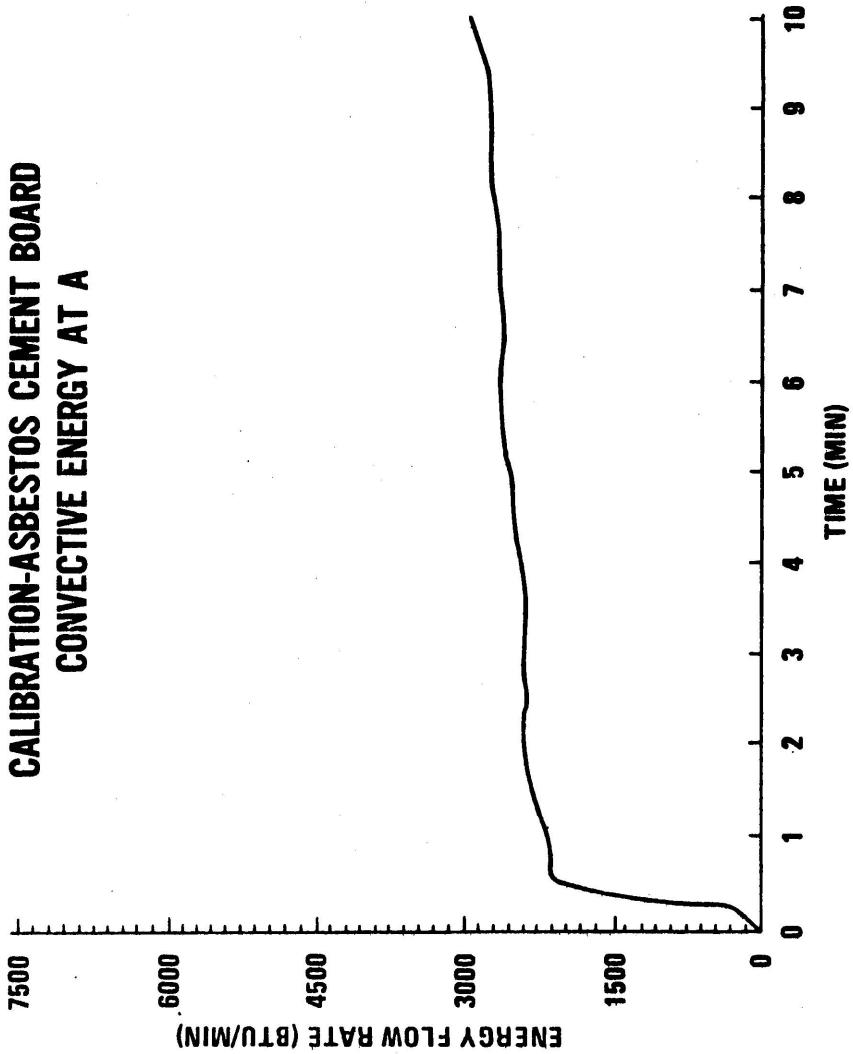


Figure 5. Enthalpy flow rate at section A for the calibration run.
(1 Btu/min = 17.57 W)

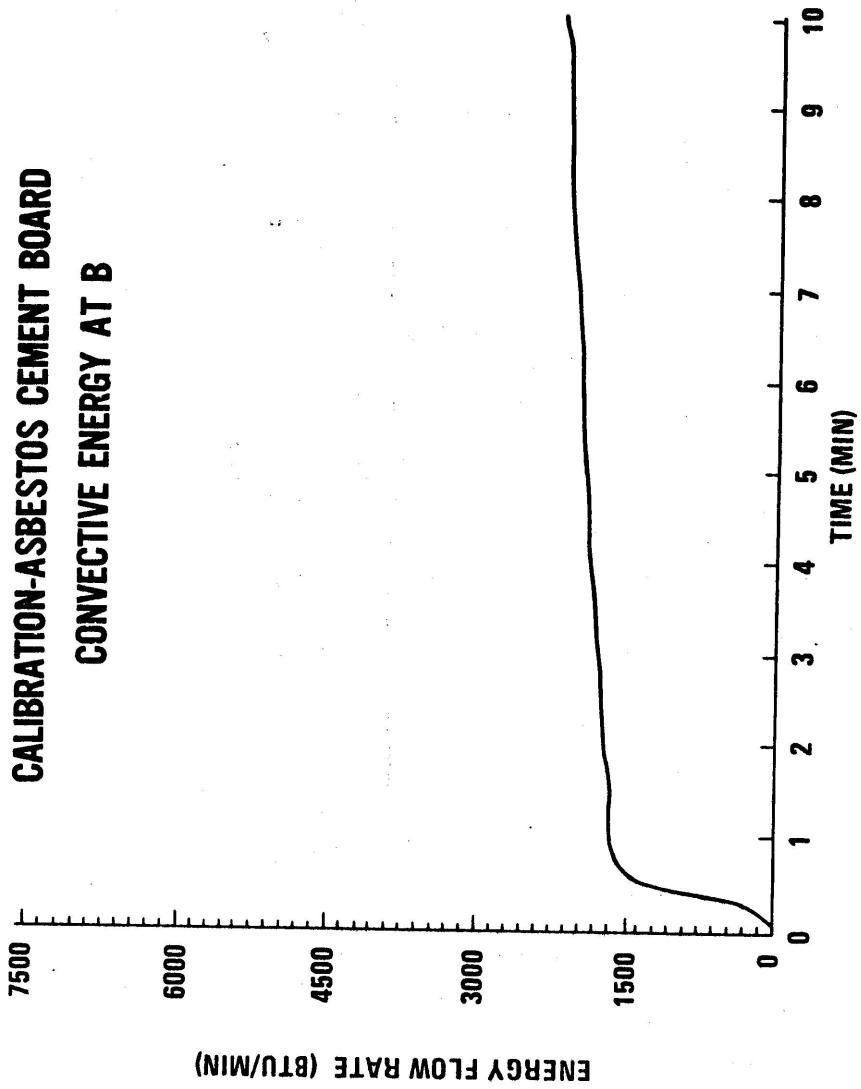


Figure 6. Enthalpy flow rate at section B for the calibration run.
(1 Btu/min = 17.57 W)

CALIBRATION-ASBESTOS CEMENT BOARD

NET ENERGY LOSS 15-24 FT

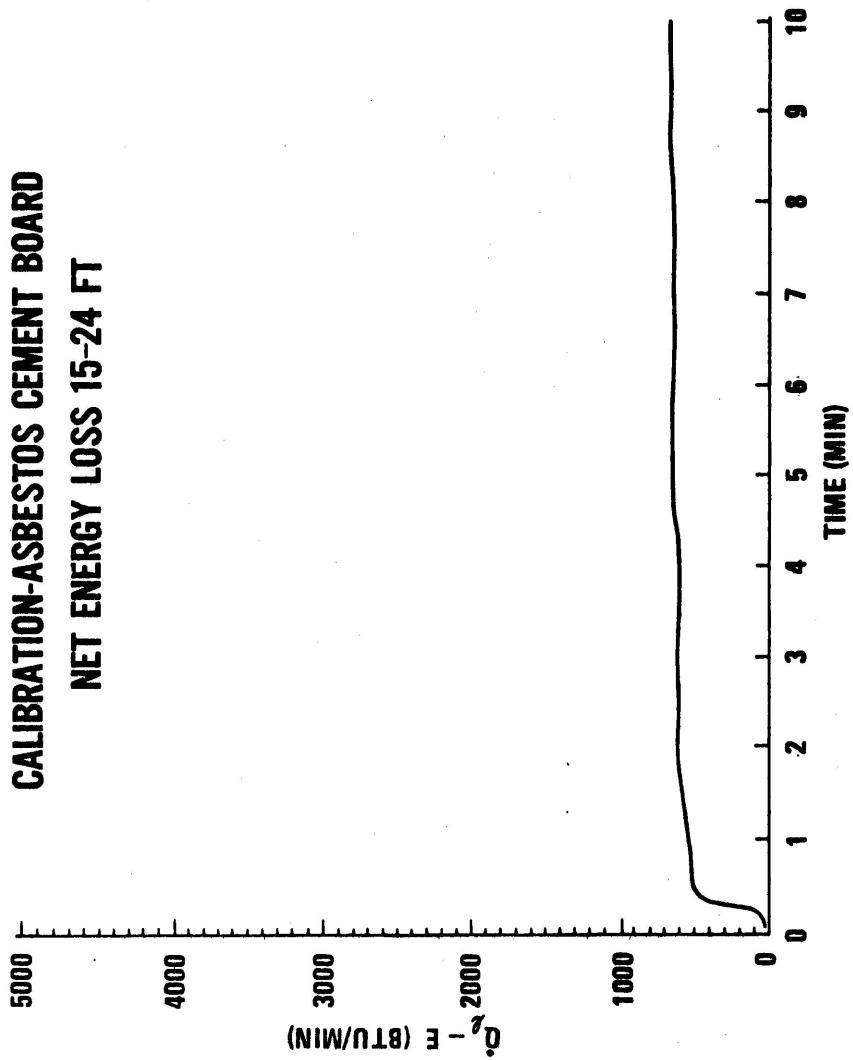


Figure 7a. Net energy loss rate between sections A and B for the calibration run.
(1 Btu/min = 17.57 W)

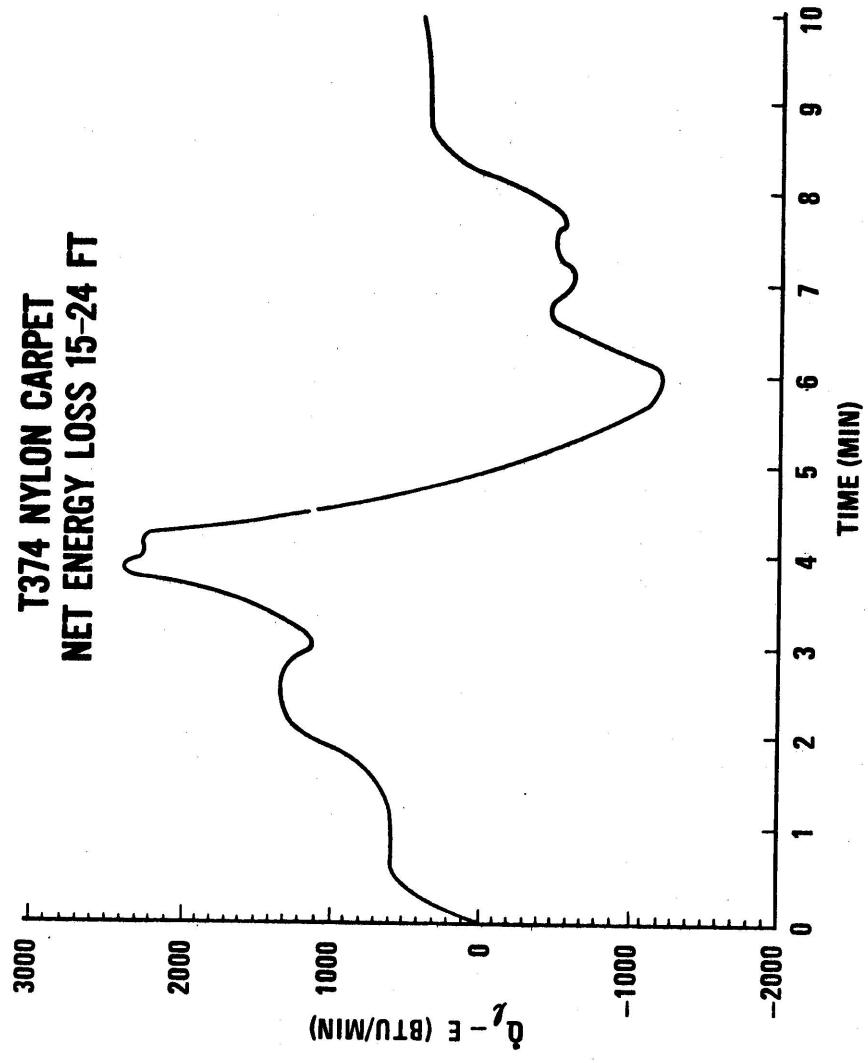


Figure 7b. Net energy loss rate between sections A and B for T374, nylon carpet.
(1 Btu/min = 17.57 W)

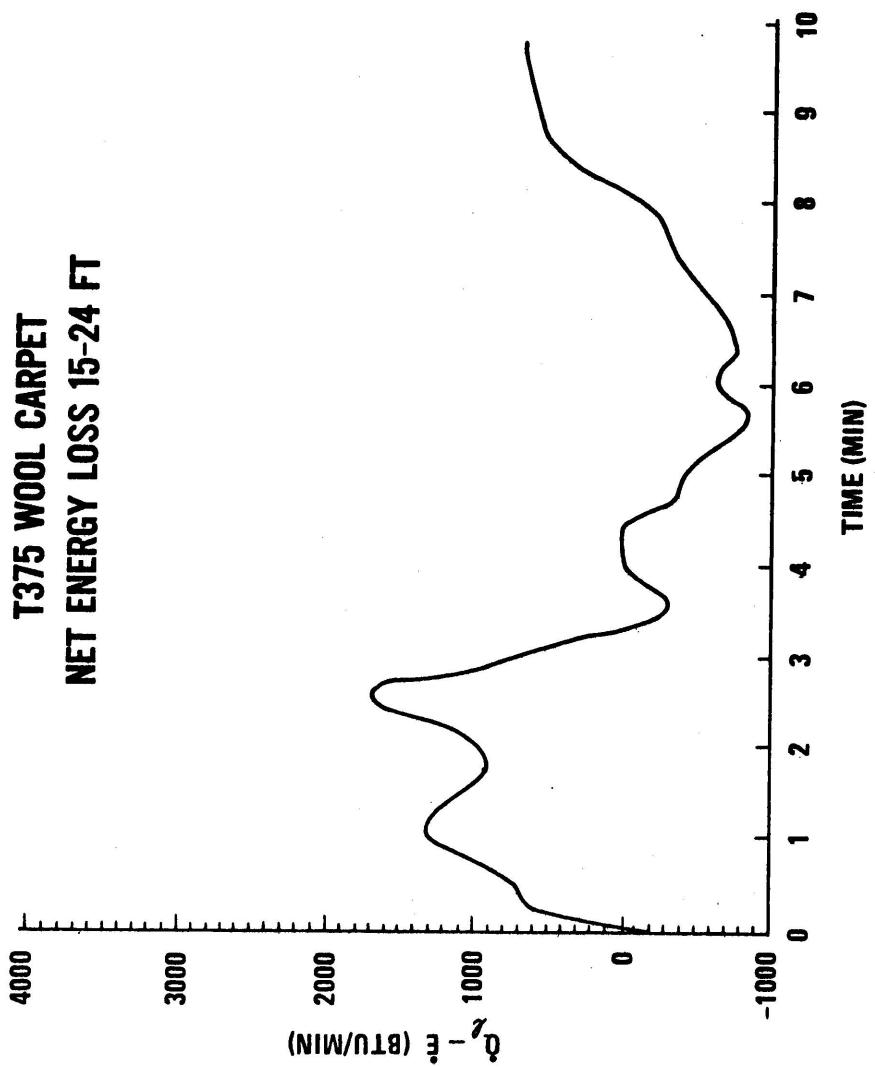


Figure 7c. Net energy loss rate between sections A and B for T375, wool carpet.
(1 Btu/min = 17.57 W)

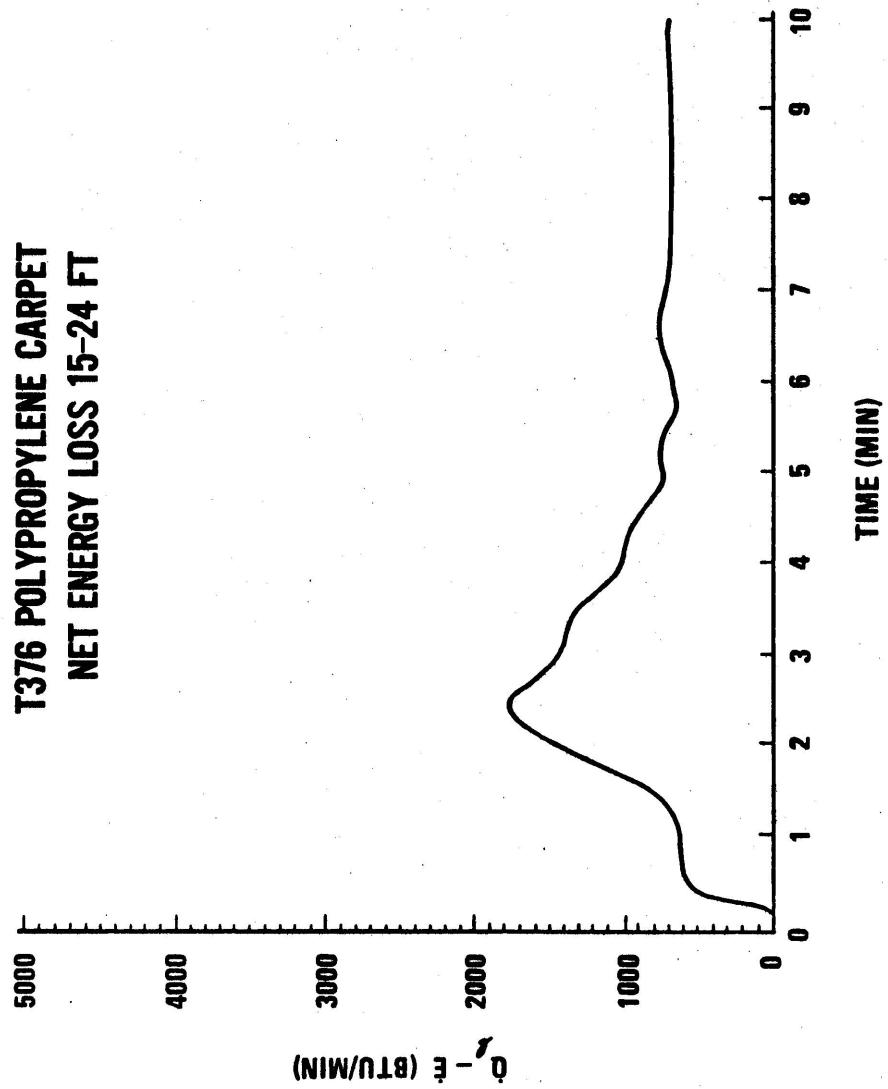


Figure 7d. Net energy loss rate between sections A and B for T376, polypropylene carpet. (1 Btu/min = 17.57 W)

U.S. DEPT. OF COMM. BIBLIOGRAPHIC DATA SHEET				1. PUBLICATION OR REPORT NO. NBS IR 75-705	2. Gov't Accession No.	3. Recipient's Accession No.
4. TITLE AND SUBTITLE Thermal and Flow Characteristics of the ASTM E 84 Tunnel Test Method				5. Publication Date September 1975		
				6. Performing Organization Code		
7. AUTHOR(S) James G. Quintiere and James W. Raines				8. Performing Organ. Report No. IR 75-705		
9. PERFORMING ORGANIZATION NAME AND ADDRESS NATIONAL BUREAU OF STANDARDS DEPARTMENT OF COMMERCE WASHINGTON, D.C. 20234				10. Project/Task/Work Unit No. 4915676		
				11. Contract/Grant No.		
12. Sponsoring Organization Name and Complete Address (Street, City, State, ZIP) same as No. 9				13. Type of Report & Period Covered Final		
				14. Sponsoring Agency Code		
15. SUPPLEMENTARY NOTES						
16. ABSTRACT (A 200-word or less factual summary of most significant information. If document includes a significant bibliography or literature survey, mention it here.) <p>Five experiments were conducted using an ASTM E 84 tunnel test facility. These included a calibration test, three standard tests involving carpet materials, and one test in which a carpet material was tested on the floor of the duct. In addition to the measurements recorded during a standard test, instrumentation was added to measure inlet air velocity, temperature within the test section of the duct, and heat flux. From these measurements mass and energy balances were determined for each experiment. The results indicate that inlet air mass flow rate dropped during a test and appears to depend on the extent of burning in the duct. The energy balance results indicate that for the calibration run about half of the energy of the gas burner is lost by radiation and convection to the walls in the test section of the tunnel. During combustion of a test specimen, significant energy losses occur in the last 9 feet of the test section even after the flame tip has reached the exit of the tunnel.</p>						
17. KEY WORDS (six to twelve entries; alphabetical order; capitalize only the first letter of the first key word unless a proper name; separated by semicolons) ASTM E 84; carpets; energy balance; flame spread; mass balance; test method.						
18. AVAILABILITY <input checked="" type="checkbox"/> Unlimited <input type="checkbox"/> For Official Distribution. Do Not Release to NTIS <input type="checkbox"/> Order From Sup. of Doc., U.S. Government Printing Office Washington, D.C. 20402, SD Cat. No. C13 <input checked="" type="checkbox"/> Order From National Technical Information Service (NTIS) Springfield, Virginia 22151				19. SECURITY CLASS (THIS REPORT) UNCLASSIFIED		21. NO. OF PAGES 38
				20. SECURITY CLASS (THIS PAGE) UNCLASSIFIED		22. Price \$ 3.75